



Table of Contents

- Terms & Conditions**
- Wire & Cable: Handling and Installation Engineering Guide**
 - Jacket Material Selection Chart**
 - EPR Performance Specifications**
 - Thermal Resistivity of Materials**
- Guide for the Installation of ACSR Twisted Pair (TP) Conductor**
- Wire & Cable: Methods of Color Coding & Color Coding Charts**
- Recommended Reel Handling Practices & Recycling/Reel Return**
 - Steel Reel Specifications**
 - Paralleling**
 - Metric Size to AWG Size**
- Copper Conductor Stranding Chart: Class A thru M**
 - Allowable Ampacities of Insulated Conductors**
- Wire & Cable: Glossary of Terms**





Terms & Conditions

PRICE

Prices are based on COMEX copper or LME aluminum listed on the quotation. Prices are subject to copper/aluminum adjustment at the time of shipment in the event that COMEX or LME copper exceeds the quoted base in excess of 10%.

CANCELLATION

Cancellation after acceptance of an order cannot be made without Seller's written consent and on such conditions as will indemnify Seller against loss for commitments made and work already complete and/or in process.

SPECIAL ORDERS

When Special Make Orders are accepted the entire order must be taken. Special Make Orders cannot be cancelled or modified once accepted and cannot be returned.

TOLERANCES

Non-Stock & Special Make merchandise is subject to the following tolerances: Total product -0 and Reel lengths +/-10%, or as specified. Exact reel lengths will incur additional charges.

DELIVERY

Any shipment schedule is approximate. Seller shall not be liable for any delay in delivery or failure to deliver caused in whole or in part by any reason beyond Seller's control.

CLAIMS

Buyer agrees to inspect merchandise for defects and for conformity, and agrees to check material against shipping papers upon unloading at destination. All claims for shortages or defective merchandise must be made by Buyer in writing within seven (7) days of receipt of shipment.

RETURNS

Return merchandise must be full reels or cartons, undamaged and in the original unopened package. Credit will be given for returned merchandise only for full reels of undamaged wire if still in the original package. No merchandise may be returned without the written authority of Seller and receipt of Seller's RMA number. No merchandise may be returned after the expiration of sixty (60) days following the date of shipment. Returns may be subject to a Restocking Fee. Non-Stock & Special Make merchandise will not be considered for return and is not subject to the previous stated return conditions.

REFUNDS

No cash refunds. Trade Credit Only. All returns and other proper claims for credit may be applied toward future purchases only or as agreed.

TAXES

Liability for all taxes imposed by any government authority with respect to the goods herein ordered shall be assumed and paid by Buyer.

MODIFICATIONS

Any modification of these Standard Terms and Conditions shall not be binding on Seller unless signed on behalf of Seller by a representative authorized to do so, regardless of whether Seller has commenced shipping of any merchandise ordered hereunder or whether Seller has accepted payments therefore.

WARRANTY

All merchandise ordered will be supplied in accordance with the description on the face of the order acknowledgment and in accordance with applicable specifications and design standards, and will be substantially free from defects in material and workmanship. The Seller's liability in respect to any defect in or failure of the merchandise supplied, as well as any loss, injury or damage attributable thereto, is limited to the replacement or repair of defects which, under proper use and handling, have been proven to the Seller's satisfaction to arise solely from faulty design, materials or workmanship, within a period of one (1) year from the date of shipment from the Seller's factory. Further, the Seller must be notified in writing of the said defect or failure within a period of one (1) year from the date of shipment. The replacement of such merchandise does not include expenses incurred in the installation or use of the material. No merchandise shall be returned to the Seller's factory or warehouse for credit or replacement before the Seller has officially advised of this transaction.

WARRANTY LIMITATIONS

This warranty does not cover the repair or replacement of any cable which fails as a result of damage in transit, misuse, neglect, accident, Acts of God, abuse, improper handling, improper storage, excessive stress, faulty or improper or unauthorized installation or repair, negligent maintenance or failure to comply with the written instructions for installation, use or maintenance provided by the Seller.

EXCLUSION OF OTHER WARRANTIES

This warranty is in lieu of all other warranties, express or implied, and all other warranties, including but not limited to the implied warranties of merchantability and fitness for a particular purpose, are expressly disclaimed.

LIMITATION OF LIABILITY AND LIMITATION OF ACTIONS

In no event shall Seller be liable for any indirect, incidental, special, punitive or consequential loss, damage or expense (which shall be deemed to include without limitation: any loss of profit or revenue, loss of goodwill, loss claimed by end-user's customers, or loss of business opportunity) of any nature or kind, however arising, whether in contract, in tort or otherwise, even if Seller is deemed to be aware of the possibility of such damages. Seller's maximum liability for any claim, loss or damage shall not exceed the purchase price for the cable subject to a claim under any circumstance, even if end-user has claims or is subject to claims in excess of this limitation. Any legal proceeding related to this warranty must be presented within (1) year after the cause of action arises.

SOLE AND EXCLUSIVE REMEDY

This document sets forth the Seller's sole and exclusive warranty obligation to the Buyer and the Buyer's sole and exclusive remedy in the event of defective cable.

CHOICE OF LAW

The laws of the State of Florida, without giving effect to its conflicts of law principles, govern all matters arising out of or relating to these Standard Terms and Conditions and all the transactions it contemplates, including, without limitation, its validity, interpretation, construction, performance and enforcement.





Wire & Cable: Handling and Installation Engineering Guide

- Receiving and Handling Cable 1
- Receipt of Cable Reels..... 1
 - 1. Visually check for shipment damage..... 1
 - 2. Inspect reel tags..... 1
 - 3. Check dimensional tolerances..... 1
- Handling of Cable Reels 2
 - Storage of Cable Reels 2
- Installation Suggestions 2
 - Safety Measures Prior to Pulling Cable 2
 - Temperature Considerations..... 2
 - Duct Sizing..... 3
 - Jam Ratio..... 3
 - Cable Clearance..... 3
 - Minimum Bending Radius (Static Conditions) 4
 - Minimum Bending Radius (Dynamic Conditions) 4
 - Cable Training (Offset Bending) 4
- Power and Control Cables without Metallic Shielding or Armor..... 4
- Power and Control Cables with Metallic Shielding or Armor..... 5
 - Clearing Ducts 5
 - Trench for Direct Burial..... 5
 - Rack/Trays 5
 - Precautions During Cable Pulling..... 5
 - Cable Guides 5
 - Cable Lubricant 5
 - Pulling Eyes & Grips 6
 - Maximum Pulling Tensions..... 6
 - A. Pulling Eye 6
 - B. Cable grips 7
 - Sidewall Bearing Pressure (Static Conditions)..... 8
 - Sidewall Bearing Pressure (Dynamic Conditions)..... 8
- Special Conditions for Metallic Armored Cables..... 9
 - Sheath Currents and Voltages in Single Conductor Cables..... 9
 - Eliminating Sheath Currents 9
 - Standing Voltage 10
- Installation of Single Conductor Cables in Parallel..... 10
 - Reel Capacities 10
 - NEMA Method 10
- Handling of Cables Reels 11
- Shipment for Unloading with a Forklift at Dock 12
- Shipment for Unloading down an Inclined Ramp 12
- Shipment for Unloading with a Forklift at Jobsite 12
- Unloading from Open Flat Bed Trailers 13
- Cable Reel Handling 14
- Excavating, Trenching, Backfilling, and Surface Restoration 15

Receiving and Handling Cable

In order to benefit from investing in underground cable (power cable), the purchaser should put into practice a complete visual inspection program that will help identify any cable that is damaged during shipment. If any cable is undesirable, it is then returned to the manufacturer instead of being installed. By recognizing and refusing damaged cable, one can considerably improve the dependability of the underground system.

Receipt of Cable Reels

Once the purchaser has received the cable shipments, they should carry out an approval inspection. A cable approval inspection involves some straightforward and low-cost steps that can yield significant dividends.

The following steps should be taken to insure proper acceptance of cable:

1. VISUALLY CHECK FOR SHIPMENT DAMAGE

Visually check cable reels for any damage that may have taken place during delivery. The purchaser should be mainly worried for cable damage if:

- a. A reel is laying flat on its side, especially if it is a large conductor size, such as 500 kcmil, 750 kcmil, or 1,000 kcmil
- b. Numerous reels are piled on top of each other
- c. Other cargo is piled on the reel
- d. Nails have been driven into the overhang to prevent overcrowding
- e. A reel overhang is broken
- f. A cable covering is detached, discolored, or broken
- g. A cable end seal is detached or broken (a broken or absent end seal means that moisture may have come into the cable)
- h. A reel has fallen (concealed damage likely)

2. INSPECT REEL TAGS

Visually check each reel to assure that it has the correct tags and labels as noted in the specifications. The reel should contain the subsequent minimum information:

- a. Purchaser's name and address
 - b. Purchase order number
 - c. Conductor size and type
 - d. Insulation thickness and type
 - e. Jacket type
 - f. Quantity of cable on reel
 - g. Beginning and ending sequential footage numbers present on the jacket
- Confirm that the cable description, reel size, and cable footage are equivalent to that specified. Any missing information should be acquired from the manufacturer.

3. CHECK DIMENSIONAL TOLERANCES

Make a straightforward measurement of the cable dimensions on one reel of each size of cable in a shipment to prove that the cable's dimensions meet the requirement.





Wire & Cable: Handling and Installation Engineering Guide

Handling of Cable Reels

To guarantee that material handling equipment does not touch or interfere with cable surfaces or with protective covering on the reel, the utmost care should be taken when moving the cable reels. **It is very important that cable reels not be dropped from any height, or be allowed to roll unrestrained.** Cable reels should be moved or lifted using the technique depicted at the end of this document.

1. For cranes, booms, or other overhead lifting equipment, a sturdy steel arbor or heavy rod or pipe should be placed in through the reel hubs so that the cable reel can be lifted by slings that make the most of spreader bars. This technique will assure that sling pressure against a reel flange, slanting of the reel, sliding of the sling, and other unstable situation will be reduced.
2. When lifting reels by fork truck type equipment, reels should only be lifted from the sides, and only if the blades of the fork truck are long enough to support both flanges. This way will make sure that the lift pressure is uniformly dispersed on both flanges and not on the cable itself.
3. Rolling reels containing cables should be kept to a minimum; if rolling is necessary, reels should always be rolled in the direction indicated by the "arrows" on the sides of the reel flanges or in the opposite direction to which the cable is wrapped onto the reel. Rolling the reels this way will avoid the release of the cable wraps, which may lead to problems during installation.
4. It is important that any debris be cleared from the path over which the cable reels are to be rolled since that might damage the cable if the reels were to roll over it. Cable reels should be rolled in the direction of the "Roll This Way" arrow and lowered in a controlled manner. The ramps should be spaced far enough apart so that they are touching the reel flanges at all times.

STORAGE OF CABLE REELS

Cable reels should not be stored on their sides if at all possible.

To prevent deterioration of the reels and moisture seeping into the cables, it is preferable to store cable reels indoors on a hard, dry surface.

If cable reels are stored outdoors they must be supported off the ground and protected with a suitable weatherproof material. The reel supports should be at least twice the width of the reel flange, long enough to provide a sufficient load bearing surface (to prevent sinking), and high enough to prevent the reel from sitting in free standing water in case of rain. Reel supports should be placed under each reel flange, and to prevent rolling each reel should be placed between the reel flange and the support at opposite sides of the flange.

All cable reels should be stored in such a way so as to allow easy access for lifting and moving, away from construction activities, falling or lying objects, sources of high heat, open flames, chemicals or petroleum products, etc. that may cause damage to the cable. It is also recommended to use fences or any other suitable barriers to protect cables and reels against damage by vehicles or other moving equipment in the storage area.

If the cable is stored on reels for future use after the factory applied end caps are removed, the exposed cable ends **MUST** be re-sealed using properly applied weatherproof end caps or by taping the ends with a tape designed to prevent moisture. PVC tapes or Duct Tape are not appropriate for preventing moisture. One must secure the loose ends of the cable reels to the reel flange and cannot lie on the ground.

Reels and end caps should be inspected from time to time if they will be stored outside for a long period of time. A once a month inspection is suitable at first but one should consider increasing this if storage time is extended since wooden reels tend to deteriorate over time and sealed end caps will lose their usefulness. Rates of deterioration will vary depending on the environment in which the reels are stored.

NOTE: If a specific method of shipping is used, such as shipping to a job site, etc., the manufacturer must be notified of these special requirements.

Installation Suggestions

Below you will find a general guide for the installation of shielded and unshielded cables, jacketed cables rated 600 to 35,000 volts in conduit, underground ducts, racks, trays or direct buried.

SAFETY MEASURES PRIOR TO PULLING CABLE TEMPERATURE CONSIDERATIONS

AWG would follow and support the guidelines in the IEEE 576 Section 8 Minimum installation temperature.

MINIMUM INSTALLATION TEMPERATURE

When installing cables under cold ambient conditions, various insulations and jacket materials become brittle and cables may be damaged if worked at too low a temperature. Table 7 gives the recommended minimum temperatures for handling and installing cables. It should be noted that these are typical values for standard compound materials; minimum temperatures will vary with special compound designs and requirements as specifications dictate.

APPLICATIONS

Table 7—Recommended minimum temperature for handling and installing cables

Type of Insulation or Jacket	Minimum Temperature for Installation
PVC	-10 °C
PCP	-20 °C
CSPE	-20 °C
CPE	-20 °C
XLPE	-40 °C
PE	-40 °C
EPR	-40 °C





Wire & Cable: Handling and Installation Engineering Guide

DUCT SIZING

Select duct size in such a way that the difference between the hoop diameter of the cable(s) and the inside diameter of the duct will not be less than 1/2". Also check that the cross-sectional area of the cable is not more than the percentage of the interior cross-sectional area of the conduit, as recommended by the National Electric Code (NEC). In addition, consider using larger ducts or additional pull boxes if long pulls are required.

JAM RATIO

Jamming might occur in bends if three cables are pulled in parallel in duct. This happens when the cables adjust from a triangular pattern to a cradled pattern as they are pulled in through the bend. This pattern change will force the two outer cables to move farther apart. The cables will also jam if the conduit diameter is too small to contain the wider pattern.

To prevent this, the jam ratio should be checked. The jam ratio corresponds to the inside diameter of the duct to the cable diameter, such that:

$$J = D \div d$$

Where:

J = Jam ratio

D = Inside diameter of duct (in)

d = Outside diameter of cable (in)

The proper cable configuration can be determined if the above jam ratio is calculated. The likely configurations are as follows:

Jam Ratio	Cable Configuration
J < 2.4	Triangular
2.4 < J < 2.6	More likely triangular
2.6 < J < 2.8	Either triangular or cradled
2.8 < J < 3.0	More likely cradled
J > 3.0	Cradled

Cable jamming tends to occur between J = 2.8 and J = 3.1. This is true if the sidewall bearing pressure (SWBP) in a bend surpasses the 1,000 lbs/foot.

CABLE CLEARANCE

In order to make sure that the cables can be pulled through the conduit, specifically in applications where the National Electric Code (NEC) limits on conduit fill do not apply, one needs to calculate the clearance between the cable(s) and conduit. The recommended calculated clearance should not be less than 0.5 inches. However, a lesser clearance, such as 0.25 inches, may be suitable for primarily straight pulls.

In addition, the clearance should contain the pulling eye or cable grip, which is used for the cable pull. The formulas below can be used to calculate the cable clearance for a single cable pull and for a three-cable pull. (Please Note: To allow for differences in cable and duct dimensions and ovality of the duct at bends, the nominal cable diameter "d" has been increased by 5%).

a. Single Cable Pull

$$C = D - 1.05 \times d$$

b. Three Cable Pull (triangular pattern)

$$C = \frac{D}{2} - 1.366 (1.05 \times d) + \frac{(D - 1.05 \times d)}{2} \times \sqrt{1 - \left[\frac{1.05 \times d}{(D - 1.05 \times d)} \right]^2}$$

Where:

C = Cable clearance (in)

D = Inside diameter of duct (in)

d = Outside diameter of cable (in)

Please reference the following table in dealing with applications where the National Electric Code (NEC) is compulsory. The table shows the most ordinary scenarios concerning the fill ratio of many cable configurations in various duct sizes.

Duct Sizes (in)	Conductor Fill Per NEC							
	1 Conductor (53% Fill Ratio)		2 Conductors (31% Fill Ratio)		3 Conductors (40% Fill Ratio)		4 conductors (40% Fill Ratio)	
	Area (in ²)	Dmax (in)	Area (in ²)	Dmax (in)	Area (in ²)	Dmax (in)	Area (in ²)	Dmax (in)
1/2	0.16	0.453	0.09	0.245	0.12	0.227	0.12	0.197
3/4	0.28	0.6	0.16	0.324	0.21	0.301	0.21	0.261
1	0.46	0.764	0.27	0.413	0.34	0.383	0.34	0.332
1 1/4	0.80	1.005	0.47	0.543	0.60	0.504	0.60	0.436
1 1/2	1.08	1.172	0.63	0.634	0.82	0.588	0.82	0.509
2	1.78	1.505	1.04	0.814	1.34	0.755	1.34	0.654
2 1/2	2.54	1.797	1.48	0.972	1.92	0.902	1.92	0.781
3	3.91	2.234	2.26	1.208	2.95	1.12	2.95	0.97
3 1/2	5.25	2.583	3.07	1.397	3.96	1.296	3.96	1.122
4	6.74	2.931	3.94	1.585	5.09	1.47	5.09	1.273
5	10.60	3.674	6.20	1.987	8.00	1.843	8.00	1.596
6	15.31	4.415	8.96	2.388	11.56	2.215	11.56	1.918

Please Note: "d_{max}(in)" is the maximum single conductor diameter that will comply with the above requirements. "Area (in²)" is the area of the conductor(s). Ground wires have not been considered in the above table. The NEC requires that "Equipment grounding or bonding conductors, where installed, shall be included when calculating conduit or tubing fill. The actual dimensions of the equipment grounding or bonding conductor (insulated or bare) shall be used in the calculation."

The below formula can be used when a calculation must be made to comply with the NEC fill ratio requirements:

$$FR = [N_{PC} \times (PC_D \div 2)^2 + N_{GC} \times (GC_D \div 2)^2] \div (C_D \div 2)^2$$

Where:

FR = Fill Ratio (%)

N_{PC} = Number of Phase Conductors with the same diameter

PC_D = Diameter of Phase Conductor (in)

N_{GC} = Number of Ground Conductors with the same diameter

GC_D = Diameter of Ground Conductor (in)

C_D = Diameter of Conduit or Duct (in)





Wire & Cable: Handling and Installation Engineering Guide

MINIMUM BENDING RADIUS (STATIC CONDITIONS)

The following formula can be used to determine the minimum values for the radii to which such cables may be bent for permanent training:

$$MBR = OD \times M$$

Where:

MBR = Minimum radius of bend (in)

OD = Outside diameter of cable (in)

M = Diameter multiplier (Please see tables on the next page(s))

Note: The above calculation applies to STATIC conditions ONLY. Please reference the DYNAMIC conditions section below and the Sidewall Bearing Pressure section for the minimum bending radius of cable in motion.

MINIMUM BENDING RADIUS (DYNAMIC CONDITIONS)

The following formula can be used to determine the minimum values for the radii to which such cables may be bent while being pulled into an installation and while under tension. This value will largely depend on the tension the cable experiences as it exits the bend. The greater the exiting tension, the greater the minimum-bending radius will be for the cable.

$$MBR = (T_e \div SWBP) \times 12 \text{ (in)}$$

Where:

MBR = Minimum radius of bend (in)

T_e = Tension as cable exits the bend (pounds x force)

SWBP = Maximum allowable Sidewall Bearing Pressure (pounds force per foot of bend radius) x

CABLE TRAINING (OFFSET BENDING)

You may use the following formula to determine the minimum distance necessary for permanent cable training (offset bending) in a manhole:


$$L = \sqrt{S(4R - S)}$$

Where:

L = Minimum distance required (in)

S = Offset (in)

R = Bending radius to cable centerline (in)

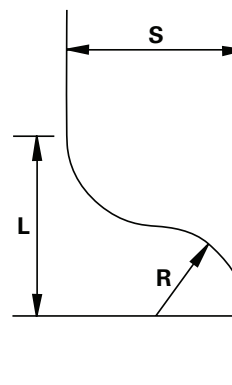

Allow a suitable length of straight cable at both ends of the offset bend.

Power and Control Cables without Metallic Shielding or Armor

Insulation Thickness (mil)	Overall Diameter of Cable (in)		
	1.000 and Less	1.001 to 2.000	2.001 and Over
Minimum Bending Radius as a Multiple of Cable Diameter			
155 and less	4	5	6
156 to 310	5	6	7
310 and over	—	7	8

Note 1: The highest applicable multiplier should be used in all cases. The calculated minimum bend radius (applicable multiplier x outside diameter of cable) refers to the inner surface of the bent cable, and not the axis (centerline) of the cable conduit.

Note 2: Use the thickest of the insulations of the cables within the assembly and the diameter of the largest single cable within the cable assembly to determine the multiplier. Afterwards, apply that multiplier to the diameter of the overall assembly.

Note 3: The minimum values for the radii to which cables may be bent during installation may not apply to conduit bends, sheaves or other curved surfaces around which the cable may be pulled under tension while being installed. Larger radii bends may be required for such conditions. (Please reference "Precautions during Cable Pulling" in the "Sidewall Bearing Pressure" section).





Wire & Cable: Handling and Installation Engineering Guide

Power and Control Cables with Metallic Shielding or Armor

Cable Type	Minimum Bending Radius	Minimum Bending Radius
	For Single Conductors	For Multiple Conductors†
Interlocked and Polymeric Armor (without shielded conductor)	7	7
Interlocked Armor and Polymeric Armor (with shielded conductor)	12	7
Wired Armored Cable	12	12
Metallic Tape Shielded Cable	12	7
Metallic Fine Wire Shield	12	7
Concentric Neutral Wire Shielded Cable	8	5
Lead Sheath Cable	12	7
LC Shielded Cable	12*	7

† Use the larger of the two minimum bending radii when considering the minimum-bending radius for multiple conductors.

*For conductor sizes 1500kcm and larger, the minimum bending radius for LC Shielded cable is 18X the cable diameter.

Note 1: Multiply the diameter of the cable by the factor in the table above to attain the minimum-bending radius.

Note 2: These limits may not be appropriate for use with conduit bends, sheaves or other curved surfaces around which the cable may be pulled under tension while being installed due to sidewall bearing pressure limits. The minimum radius specified refers to the inner radius of the cable bend and not to the axis of the cable.

CLEARING DUCTS

Using a plug that is roughly the same diameter as the inside of the duct does not permit obstructions in the duct since it pulls the plug through the structure. After doing this, use a wire brush to clean and remove foreign matter from the duct. In order to prevent scratch damage to the cable jacket during pulling, it is important to smooth the interior.

TRENCH FOR DIRECT BURIAL

To prevent damage to the cable jacket during or after cable installation, the trench should be clean of sharp stone, glass, metal or wood debris. The trench bottom should be evenly covered with a layer of soil or sand that has been screened through a medium-to-fine mesh screen to remove all larger stones or other material. This will assure a smooth, soft-bedding surface for the cable(s). It is a good idea to lay a protective covering on the fill about 6-8 inches above the cable to protect it if working in an urban area or near where a lot of digging occurs. If working under highways or railroad rights-of-way, it is also a good idea to install the cable in a pipe or conduit to give added mechanical protection.

RACK/TRAYS

One should check the entire path that the cable will follow during pulling to make sure that the cable will have a smooth ride, free of all barriers or sharp edges. In checking this, one should consider the position the cable will take on when under tension.

PRECAUTIONS DURING CABLE PULLING

CABLE GUIDES

All guides should be in the form of large diameter, smooth-surfaced, free-turning sheaves or rollers to prevent damage to the cable jacket when guiding the cable from the reel to the duct mouth or trench. Guide tubes or chutes must be smooth, burr-free working surfaces with the largest possible bend radii and be securely anchored if used. Mounting the cable reel in sturdy jacks, leveling the reel shaft and lubricating the reel arbor holes with grease will lead to low cable tension. If breaking the reel needs to happen, it should only be done to prevent reel over-run when the pull is slowed or stopped, or on steep downhill runs where cable weight is enough to overcome cable-duct friction.

This information also applies for rack or tray installations. The following points should be noted when making such pulls:

1. Cable support rollers should be spaced close enough so that the cable's normal sag, even when under tension, will not result in tray dragging.
2. The cable rollers should be contoured so that the cable will not ride off the end of the roller or be "pinched" into a sheave contour diameter that is smaller than that of the cable.
3. When rollers or sheaves are used to guide the cable through the bends, it is important that enough of them be used to guide the cable in a smooth curve of the desired radius from tangent point to tangent point. If this is not done, the cable may be "kinked" around the radius of each roller.

The cable may be paid off the reel and laid into the trench as the reel is moved along the length of the trench in cases of direct-burial installations. When this happens, the cable is laid on a bed of soil or sand.

If the cable needs to be pulled through the trench, the best way to do so is to support the cable on temporary rollers so that the cable does not drag over the soil or sand bed. If one does not have rollers handy, sacks filled with very fine sand or other fine powdery material may be used as an alternative to support the cable and keep it from dragging on the trench bed during the pulling process.

CABLE LUBRICANT

To reduce pulling tensions and damage on cables, lubricants may be used in conduit. When using cable or pulling lubricants, one should avoid compounds that may contain oils or greases since they may damage the cable jackets. Also, pulling lubricants that contain micro-spheres or micro-balls should be avoided for medium-voltage cable installations. These kinds of lubricants are meant to be used on low-tension pulls that are not representative of power cable pulls.

Most commercially available pulling lubricants can be used with little worry for compatibility. But, one does need to keep in mind that some pulling lubricants react poorly to some cable jacket compounds, which may lead to ruining the cable jacket. It is best to avoid damage to the cable jacket by consulting the cable manufacturer regarding lubricant compatibility with specific jacket compounds.





Wire & Cable: Handling and Installation Engineering Guide

PULLING EYES & GRIPS

Pulling eyes attached to the cable conductor(s) are used for large, heavy cable, or for cables where the pulls are very long or contain numerous bends. To use the pulling eye, one must fasten it directly to the conductor(s) on the end of the cable by soldering the copper conductors into a socket-type eye, or by mechanically compressing the aluminum conductors into an aluminum eye. Then, a tape seal or heat-shrinkable tube is placed over the eye-cable joint to provide a reliable weather-tight seal for the cable during pulling. For armored cables, the armor needs to be properly secured to the eye to insure the reliability of the cable during pulling. Generally, pulling eyes tend to be installed at the factory; however, they can also be installed in the field.

Often times, woven wire pulling grips, generally called “baskets” are used to pull armored cables; they are well suited for pulling smaller size voltage cables, or where the pulls are fairly short. Special measures need to be taken if using “baskets” on Interlock Armored cables to avoid damage to the cable or problems in making the pull. The pulling grip may tend to stretch the armor if the grip is not properly secured to the cable. The following method for preparing the cable and attaching the grip is advised:

1. Select the grip size that fits the cable diameter or armor best. Determine the length of the gripping portion of the grip.
2. Find two points on the end of the cable. The first is 75% of the grip length from the end; the second is 100% of the grip length from the end.
3. Get rid of the sheath/armor, and also the outer jacket if there, to the first mark. Do not damage the core of the armor. If need be, secure the armor at the cut point with friction tape before cutting.
4. Apply four, 3-inch long, tight wrappings of friction tape. Place this tape on a) the end of the core, b) on the core to the edge of the sheath/armor, c) on the jacket, or sheath/armor to the edge of same, and d) on jacket, or sheath/armor where the last 3 inches of grip will be.
5. If cable will be exposed to moisture during the pull, seal the cut ends of the conductors with sealing mastic and vinyl tape, or heat-shrinkable cap(s).
6. Place the grip on the cable and secure it tightly by “milking” it from the cable end towards the end of the grip.
7. Clamp the back end of the grip to secure it to the cable with a steel hose clamp, such as the “Band-It” types, or a tough steel wire that is firmly applied.
8. Over the clamp apply a tape wrapping to smooth it and prevent drag during the pull.

CAUTION: The ends of cable pulled this way will not be entirely safe from water. If this is an issue, properly applied pulling eyes should be used.

***NOTE:** The force applied by pulling a grip may damage or disrupt the underlying cable, so it is best to cut off the section immediately below the grip as well as the three feet of cable behind the grip before fixing together.

MAXIMUM PULLING TENSIONS

To prevent damage to the cable, pulling tensions for installing electrical cables should be maintained as low as possible. This may be done through proper use of size ducts or conduits, by avoiding long pulls, and avoiding runs that may contain sharp bends or severe changes in elevation.

The following maximum allowable pulling tension must not be passed when pulling cable by the method indicated.

A. PULLING EYE

The maximum tension for cables pulled with a pulling eye should not exceed the value calculated using the following formula:

$$T_{\max} = CTC \times CA \times N$$

Where:

T_{\max} = Maximum pulling tension (lb)

CA = Conductor Area (cmil)

N = Number of conductors being pulled

CTC = Conductor Tension Constant

For CTC with aluminum compression eyes or blots use:

0.011 – Copper conductor

0.008 – Aluminum Stranded conductor

0.006 – Aluminum Solid conductor

For CTC with filled eyes or bolts use:

0.013 – Copper conductor

0.011 – Aluminum Stranded conductor

0.008 – Aluminum Solid conductor

NOTE: When calculating the maximum pulling tension, DO NOT consider the area of neutral or grounding conductors in cable(s). The number of conductors should be reduced by one (1) when calculating the maximum tension for parallel cable assemblies. The “N” can equal the number of cables in the assembly, excluding ground wires. This number can also be reduced by one (1) as an extra measure.





Wire & Cable: Handling and Installation Engineering Guide

PULLING EYE MAXIMUM PULLING TENSION (LBS)

Size	Copper			Stranded Aluminum		
	1/C Single	3-1/C Parallel	3-1/C Triplex	1/C Single	3-1/C Parallel	3-1/C Triplex
8 AWG	181	362	543	132	264	396
7 AWG	229	458	687	166	332	498
6 AWG	288	576	864	209	418	627
5 AWG	363	726	1089	264	528	792
4 AWG	459	918	1377	333	666	999
3 AWG	578	1156	1734	420	840	1260
2 AWG	729	1458	2187	530	1060	1590
1 AWG	920	1840	2760	669	1338	2007
1/0 AWG	1161	2322	3483	844	1688	2532
2/0 AWG	1464	2928	4392	1064	2128	3192
3/0 AWG	1845	3690	5535	1342	2684	4026
4/0 AWG	2327	4654	6981	1692	3384	5076
250 kcmil	2750	5500	8250	2000	4000	6000
300 kcmil	3300	6600	9900	2400	4800	7200
350 kcmil	3850	7700	11550	2800	5600	8400
400 kcmil	4400	8800	13200	3200	6400	9600
450 kcmil	4950	9900	14850	3600	7200	10800
500 kcmil	5500	11000	16000	4000	8000	12000
550 kcmil	6050	12100	18150	4400	8800	13200
600 kcmil	6600	13200	19800	4800	9600	14400
650 kcmil	7150	14300	21450	5200	10400	15600
700 kcmil	7700	15400	23100	5600	11200	16800
750 kcmil	8250	16500	24750	6000	12000	18000
800 kcmil	8800	17600	26400	6400	12800	19200
900 kcmil	9900	19800	29700	7200	14400	21600
1000 kcmil	11000	22000	33000	8000	16000	24000

B. CABLE GRIPS

When using a cable grip to pull cables, the maximum tension should not exceed the value shown in the following two tables, or the formula used in the table above.

PULLING GRIPS MAXIMUM PULLING TENSION (LBS)

Type of Cable	PE, XLPE Insulated		EPR Insulated	
	Single Cable	Multiple Cables	Single Cable	Multiple Cables
Unshielded, with or without Jacket	2000	2000	2000	2000
Concentric Wire URD with Jacket	10000	5000	10000	10000
Concentric Wire URD without Jacket	10000	5000	6000	3000
Taped Shielded with Jacket	10000	5000	10000	10000
Fine Wire Shielded with Jacket	10000	5000	10000	10000
LC Shielded with Jacket	8000	4000	5000	2500
Polymeric Armored Cables (See Note 3)	—	—	10000	10000
Interlock Armor with PVC Jacket	5000†	—	5000†	—
Interlock Armor with PE Jacket	5000†	—	5000†	—
Lead Sheathed Cables	See Subsequent Table			

† Interlock Armor pulling tension using pulling grips should be limited to the lesser of the value provided above or 50% of value of T_{max} calculated using "Pulling Eye" formula.

Note 1: The above tensions correspond to three cables in one grip. The stress on the cable conductor should not exceed 16,000 psi (0.013 lbs/cmil) for annealed copper conductors when using a grip. For stranded 3/4 and full hard aluminum conductors the stress should not exceed 14,000 psi (0.011 lbs/cmil) and 10,000 psi (0.008 lbs/cmil) for solid 1/2 to full hard aluminum conductors. The allowable conductor stress should be based on two cables sharing a load for three single conductor cables in parallel and triplexed configurations.

Note 2: The manufacturer of the cable(s) used should be contacted to determine the mechanical limitations of the cable(s).

Note 3: It is recommended that pulling grips be used during installation of Polymeric Armored Cables, due to their higher sidewall bearing pressure capabilities.

PULLING GRIPS MAXIMUM PULLING TENSION (PSI)

Type of Cable	PE, XLPE Insulated		EPR Insulated		Paper Insulated	
	Single Cable	Multiple Cables	Single Cable	Multiple Cables	Single Cable	Multiple Cables
Lead Shielded	16000 (Note 4)	16000 (Note 4)	8000 (Note 5)	8000 (Note 5)	1500 (Note 6)	1500 (Note 6)

Note 4: The maximum pulling tension stress limit for pulling grips on lead sheathed cable with XLPE or TR-XLPE insulation is 16,000 psi of lead sheath area for a single cable as well as one grip on three cables (per AEIC CG5-2005).

Note 5: The maximum pulling tension stress limit for pulling grips on lead sheathed cable with EPR insulation is 8,000 psi of lead sheath area for a single cable as well as one grip on three cable (per AEIC CG5-2005).

Note 6: The maximum pulling tension stress limit for pulling grips on lead sheathed cable with Paper insulation is 1,500 psi of lead sheath area for a single cable as well as one grip on three cables (per IPCEA P-41-412-1958).





Wire & Cable: Handling and Installation Engineering Guide

SIDEWALL BEARING PRESSURE (STATIC CONDITIONS)

The dynamic radial pressure of cable which is pulled around a bend under pulling tension should be kept as low as possible and not exceed the following values listed in the table. To calculate these values use the following formula:

$$P_{sw} = T_e \div B_r$$

Where:

P_{sw} = Sidewall Bearing Pressure in pounds per foot of bend radius

T_e = Pulling Tension as cable exits the bend (lbs)*

B_r = Bend radius, in feet

***Note: The maximum pulling tension determined by the above formulas must be observed.**

SIDEWALL BEARING PRESSURE (DYNAMIC CONDITIONS)

To calculate the minimum bending radii for dynamic conditions, use the following formula:

$$MBR = (T_e \div P_{sw}) \times 12$$

Where:

MBR = Minimum Bending Radius (in)

T_e = Pulling Tension as cable exits the bend (lbs)*

P_{sw} = Maximum Sidewall Bearing Pressure in pounds per foot of bend radius from following table

***Note: The maximum pulling tension determined by the above formulas must be observed.**

SIDEWALL BEARING PRESSURE (LBS/FT OF BEND RADIUS)*

Type of Cable	PE, XLPE	EPR
	Insulated	Insulated
Unshielded, without Jacket	1200	500
Unshielded, with Jacket	1200	1000
Interlock Armor with PVC Jacket Single Conductor & Three Conductor having round core (100% fillers)	800	800
Interlock Armor with PE Jacket Single Conductor & Three Conductor having round core (100% fillers)	1000	1000
Concentric Wire URD, without Jacket	1200†	1000†
Concentric Wire, Encapsulating Jacket	2000	2000
Concentric Wire, with Sleeved Jacket	1500	1500
LC Shielded with Jacket	1500	1500
Taped Shielded with Jacket	1500	1500
Fine Wire Shielded with Jacket	1500	1500
TECK90 Cable, Single Conductor & Three Conductor having round core (100% fillers)	800	800
TECK90 Cable, Three Conductor with minimal or no fillers	350	350
Lead Sheathed (Solid Dielectric)	2000**	2000**
Polymeric Armored Cables	Air Bag®	2400
	AirGuard®	3000
Lead Sheath (PILC)	400	

† Value shown corresponds to a single conductor cable pull. Maximum Sidewall Bearing Pressure limits of 750 and 200 lbs. per foot, respectively, are recommended for a three-conductor pull.

* For a pulling eye/pulling grip, the maximum pulling tension must be observed in addition to the maximum sidewall bearing pressure limit.

** These values are based on the cross-sectional area of one lead sheath.

Note 1: It is recommended that the manufacturer of the cable(s) in question be contacted concerning the mechanical limitations of the cable.





Wire & Cable: Handling and Installation Engineering Guide

Special Conditions for Metallic Armored Cables

SHEATH CURRENTS AND VOLTAGES IN SINGLE CONDUCTOR CABLES

A voltage is induced in the concentrically applied wires of the grounding conductor and the armor in a single conductor cable with an interlocking armor.

A current will flow in the completed path if the armor and the concentric grounding conductor are bonded or grounded at more than one (1) point. The magnitude of the induced voltage is relative to the magnitude of the current in the phase conductor. The magnitude of the sheath currents is a function of the induced voltage and the sheath impedance. The armor and the grounding conductor can become very hot if the sheath current is large. If this occurs, the conductor insulation will also be subjected to temperatures that may cause electrical failure or reduce the life expectancy of the cable.

One will have to derate the cable if sheath currents are large enough to raise the temperature of the insulation above its rated value.

In a single conductor cable carrying currents less than 180 amps, sheath currents will not pose a problem since induced voltages and sheath impedances minimize sheath losses.

In single conductor cables carrying currents between 180 and 425 amps, sheath currents will not pose a problem if the cables are spaced about one (1) cable diameter apart. When this spacing is done, mutual heating is minimized and the induced voltage is reduced by virtue of field cancellation.

In single conductor cables carrying currents larger than 425 amps, it is normally necessary to derate the cables to avoid overheating unless the sheath currents are removed.

Armor of magnetic material (such as galvanized steel) should not be used on single conductor cables intended for use in AC circuits.

ELIMINATING SHEATH CURRENTS

One needs to make sure that all paths by which sheath currents circulate are kept open in order to prevent the current from flowing. One should ground and bond cable armors and concentrically applied grounding conductors at the supply end only and afterwards isolated from ground and each other. Isolation may be established when installing cables in individual ducts by using cables with PVC jackets or other insulating materials, or also by mounting cables.

No sheath current will flow if the armors and concentrically applied grounding conductors are bonded and grounded at the supply end through a non-ferrous metal panel and mounted on an insulated panel at the load end. For an illustration of this, please see the figure down below.

- Cables enter supply end enclosure through metallic non-ferrous panel to avoid overheating. Cable armors are bonded through panel.
- Cable enters load end enclosure through panel of insulating material. The insulating material maintains the open circuit of the armors.
- Cable armors and concentrically applied grounding conductors are bonded and grounded at the supply end only. When installed in this way, the armor and concentric grounding conductor do not form a part of the system ground circuit and a separate ground conductor should be installed, following the proper electrical code.
- All cable connectors and lock nuts are made of non-magnetic metal (aluminum or other).






Wire & Cable: Handling and Installation Engineering Guide

STANDING VOLTAGE

An induced voltage will exist between ground and both the armor and the concentric grounding conductor throughout the length of the cable when single conductor cables are installed, as shown in the figure below:

The magnitude of this voltage is proportional to the phase conductor

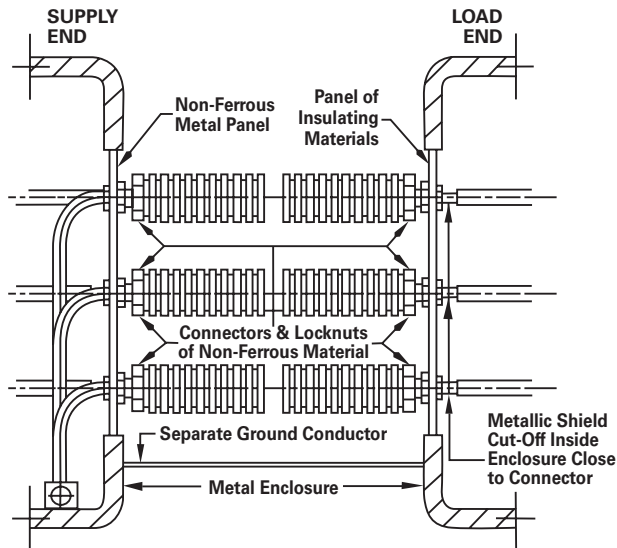

current, the cable length and the spacing between the cables. The magnitude of the “standing voltage” is usually limited to about 25 volts. Please be aware that some Electrical Inspection Authorities limit this voltage to a lower amount.

By grounding the armor and the concentric grounding conductor at the midpoint of the cable run, one can limit the standing voltage and also increase the circuit length. If doing this, the cable must go through a junction box at the midpoint of the run and must be connected on each side of the junction box as shown on the supply end of the figure above. In this case, the cables at both the supply and load ends must be connected through panels of insulating material to prevent the flow of sheath currents. Nevertheless, when two (2) or more single conductor cables are installed in parallel per phase, grounding at the midpoint is not allowed. For more on installing single conductor armor cables in parallel please see the diagram below, which depicts symmetrical configurations:

Installation of Single Conductor Cables in Parallel

SINGLE PHASE	THREE PHASE
TWO (2) CONDUCTORS PER PHASE	TWO (2) CONDUCTORS PER PHASE
<p style="text-align: center;">A B B A</p>	<p style="text-align: center;">A B C C B A</p> <p style="text-align: center;">OR</p> <p style="text-align: center;">A B C</p> <p style="text-align: center;">C B A</p> <p style="text-align: center;">OR</p> <p style="text-align: center;">C C</p> <p style="text-align: center;">A B -s- A B</p>
THREE (3) CONDUCTORS PER PHASE	THREE (3) CONDUCTORS PER PHASE
NOT RECOMMENDED	<p style="text-align: center;">C C C</p> <p style="text-align: center;">A B -s- A B -s- A B</p>
FOUR (4) CONDUCTORS PER PHASE	FOUR (4) CONDUCTORS PER PHASE
<p style="text-align: center;">A A B B B B A A</p> <p style="text-align: center;">OR</p> <p style="text-align: center;">A B B A</p> <p style="text-align: center;">A B B A</p>	<p style="text-align: center;">A B C C B A</p> <p style="text-align: center;">A B C C B A</p> <p style="text-align: center;">OR</p> <p style="text-align: center;">C C C C</p> <p style="text-align: center;">A B -s- A B -s- A B -s- A B</p>

Notes:

1. S = Separation of groups. This equals the width of one group.
2. Horizontal and vertical separation between adjacent cables should be a minimum of one (1) cable diameter to benefit from the ampacity in free air in a ventilated cable tray.
3. Neutral conductors can be located outside of the above groups.

REEL CAPACITIES

NEMA METHOD

The formula for calculating footage capacities of reels for round cable is shown below. A 5% factor and 95% traverse utilization have been built into the formula. Cables must be wound evenly to obtain consistency.

$$F = \frac{\pi}{12} \left\{ \left[B + \left(\frac{A - 2 \times X - B}{1.9 - D} \right)^* \right] \cdot 0.95 \times D \right\} \left[\frac{A - 2 \times X - B}{1.9 - D} \right]^* \left[\frac{0.95 \times C}{D} \right]^* \}$$

* Round off the result to the nearest whole number.

Where:

F = Feet of cable on reel

A = Flange diameter, in inches

B = Drum diameter, in inches

C = Inside traverse, in inches

D = Cable diameter, in inches

X = This variable is defined as the distance between the cable and the outside edge of the reel flange. Clearance is equivalent to 1 inch or 1 cable diameter, whichever is the larger quantity.


Note: The NEMA formula does not cover paralleled or triplexed assemblies. Contact the cable manufacturer for the maximum footages of these assemblies.






Wire & Cable: Handling and Installation Engineering Guide

Handling of Cables Reels

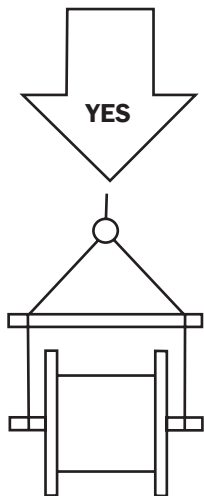


Reels should be lifted with a shaft extending through both flanges.

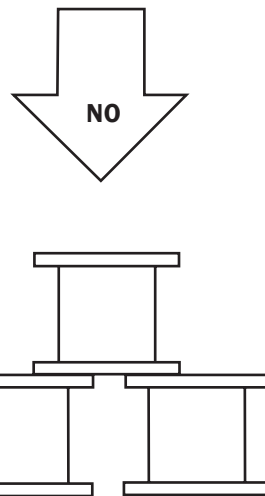


Inspect all reels. Reels laying flat should be refused or received subject to inspection.




Reels should be lowered using hydraulic gate, hoise or forklift.
LOWER CAREFULLY.

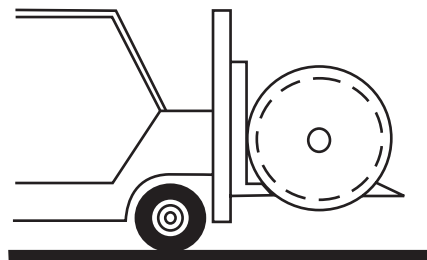

Do NOT allow forks to touch cable or reel wrap.

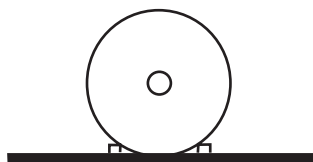

Load with flanges on edge and chock securely..

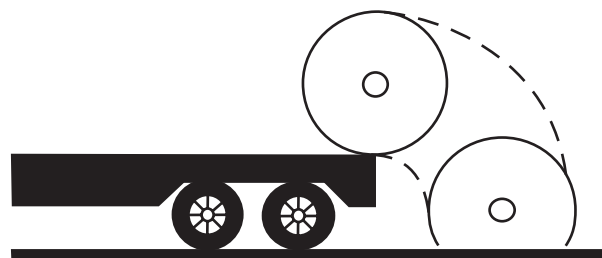


Never drop reels from trailer.






Wire & Cable: Handling and Installation Engineering Guide


Shipment for unloading with a forklift at dock

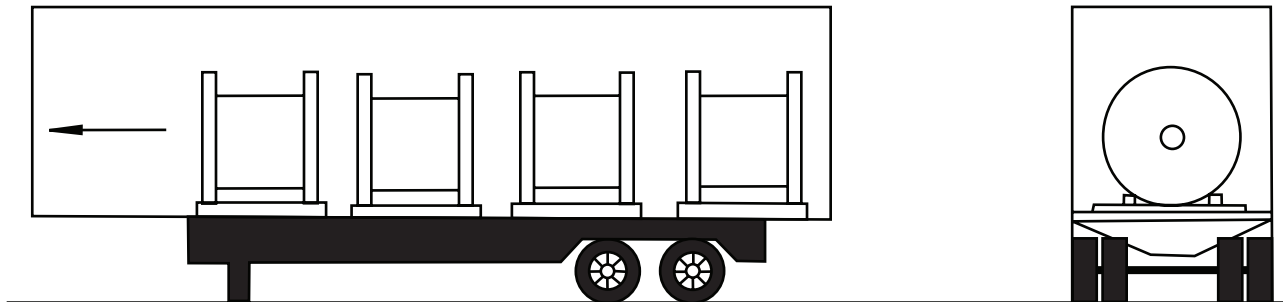

Shipment for unloading down an inclined ramp

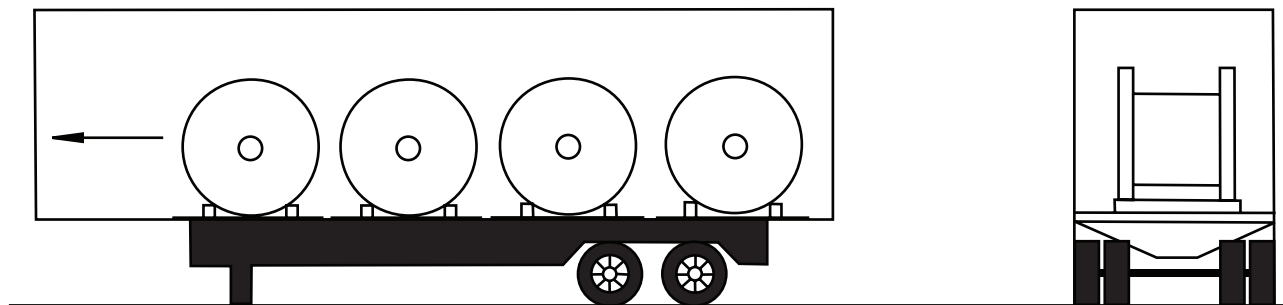




Shipment for unloading with a forklift at jobsite

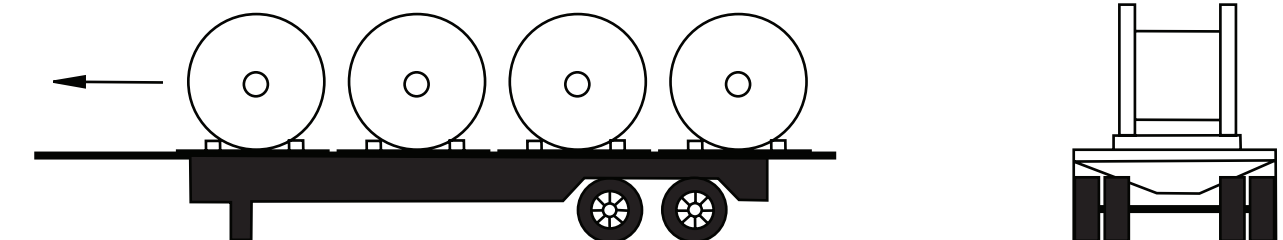



Wire & Cable: Handling and Installation Engineering Guide


Unloading from Open Flat Bed Trailers

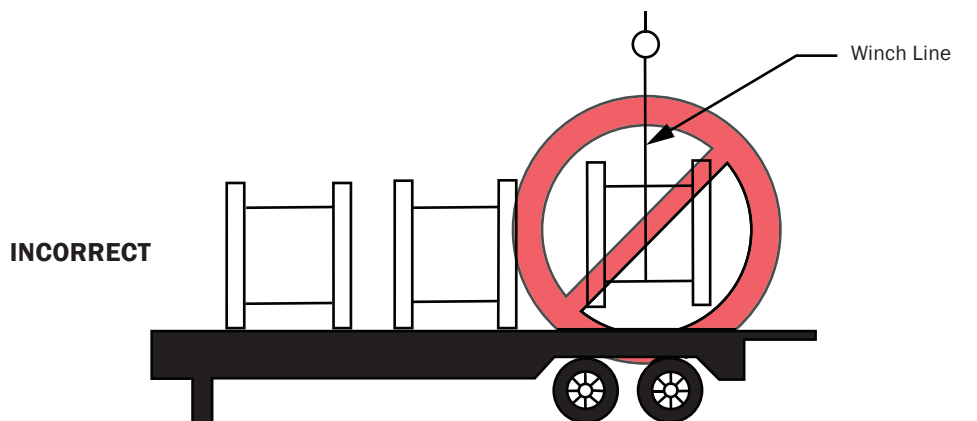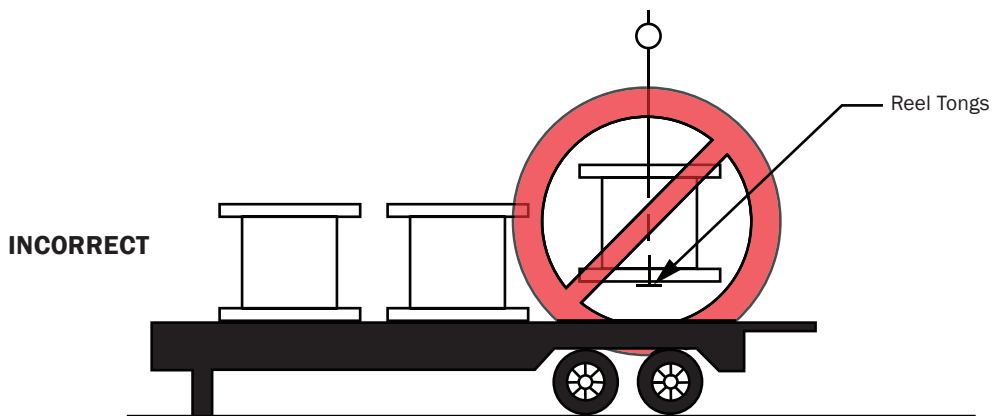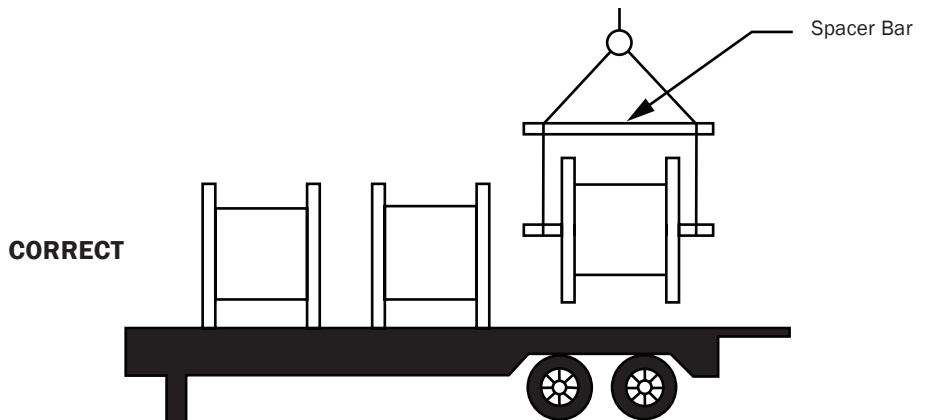




Wire & Cable: Handling and Installation Engineering Guide


Cable Reel Handling

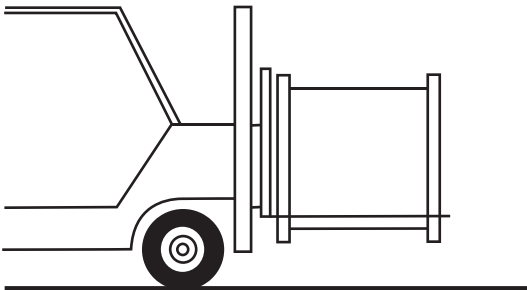


Do NOT allow forks to touch cable or reel wrap.

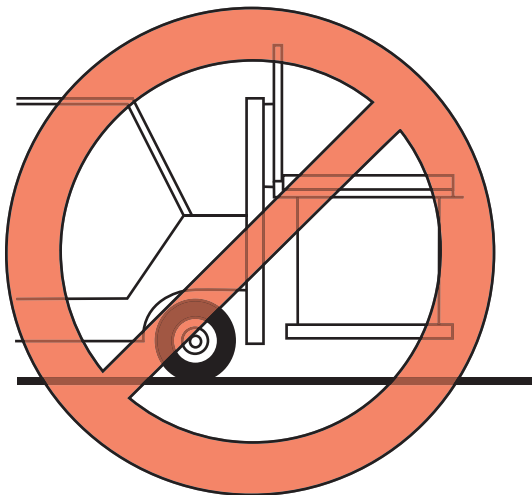

Do NOT allow forks to touch cable or reel wrap.

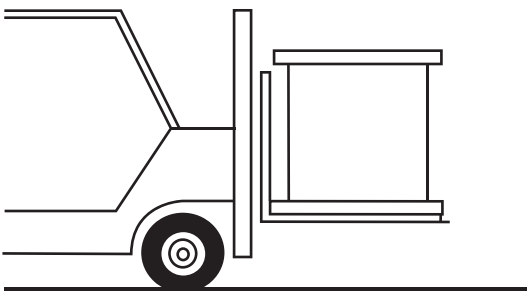

Do NOT allow forks to touch cable or reel wrap.
This method OK for Low Voltage Cable only!

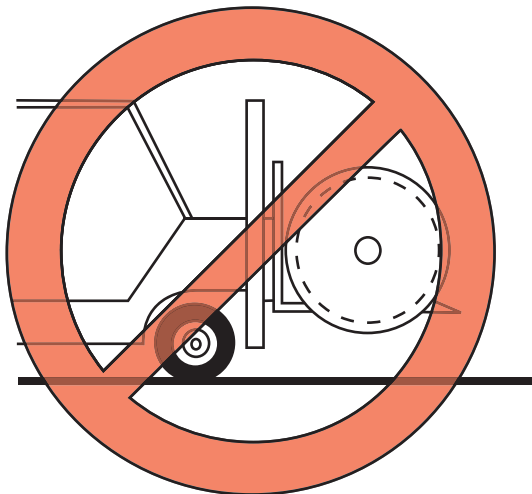

Do NOT allow forks to touch cable or reel wrap.





Wire & Cable: Handling and Installation Engineering Guide

Excavating, Trenching, Backfilling, and Surface Restoration

PRODUCTS

EXCAVATED BACKFILL MATERIALS

- Backfill shall be free of roots, stumps, rubbish, and stone, concrete and clay lumps larger than one-third cubic foot.
- Remove and dispose of unsuitable material in backfill.

EXECUTION

PREPARATION

- Verify location of existing underground utilities.
- Protect all existing underground facilities.
- Protect all existing above ground facilities and structures.
- Provide for continuance of use of all utilities.

TRENCHING

- Cut existing surfaces to expose area for trenching.
- Bore below all asphalt surfaces.
- No classification of excavated material will be made.
- Strip topsoil and stockpile for replacement/restoration
- Excavate trench to required line and grade.
- Keep trench width to a minimum to allow proper jointing of utility and compaction of bedding and backfill.
- Organize operations to keep time of open trench to a minimum.
- Excavation by blasting will not be allowed.
- Trench bottom shall be firm for entire length and width.
- Remove unstable material from trench bottom and replace with approved bedding.
- Remove rock, shale and hardpan to one foot below bedding elevation and replace with approved foundation material.
- Keep trenches free from water.
- Dispose of excavated material not used or suitable for use as backfill.
- Stabilize unstable trench walls.
- Protect bottom of trench from frost. Do not place structures or conduit on frozen ground.

BACKFILLING AND COMPACTING

- Do not start encasement backfilling until work which will be covered is completed and areas are free of foreign material.
- Restore underground facilities interfered with to original condition.
- Place minimum of two feet of backfill over initial encasement before beginning compaction operations.
- Compaction by flooding will not be allowed.
- Level depressions in finished trench.
- Replace topsoil.
- Backfill compaction - 85% of standard proctor density unless otherwise specified on drawings.
 - Testing fees will be paid by the Contractor.

SURFACE RESTORATION

- Provide surface restoration to match existing conditions.

DRAIN TILE REPAIRS

Contractor shall use good engineering and construction practices to minimize damage to existing drainage tiles and waterways in order to minimize damage to existing drainage. Contractor shall consult with landowners to determine locations of existing tiles, if known, prior to construction.

In the event that Contractor damages drainage tiles or waterways during construction, Contractor shall repair or replace the damaged tiles and restore the damaged waterways, either at their original location or at such other location as will accomplish their original purpose.

Suitable fill material shall be placed under the repaired or replaced tile to minimize settling.

Contractor shall coordinate drainage tile repair such that Landowner's representative may observe such work by Contractor, provided such representative must be available in accordance with Grantee's construction schedule.

All underground power lines (including ground cables) shall be installed at least 4 feet below finished ground elevation. During construction, if Contractor encounters underground drainage tiles while trenching for underground lines, Contractor shall install underground lines below the drainage tiles unless the drainage tiles are 6 feet or more below the surface, in which case the underground lines shall be installed above the drainage tiles.

Upon Completion of the work, Contractor shall provide a site map showing the "as built" location of the underground transmission lines on the Property.

TESTING

BACKFILL COMPACTION TEST

Compaction tests shall be performed at a depth of one and 1.5 feet above the cables and 3 feet above the cables.

Compaction tests shall be performed every 500 feet for the first mile and every mile thereafter.

Care is to be taken when compacting under, alongside, and immediately above the cable to avoid crushing the insulation and to preserve the trefoil configuration of the cable.

COMPACTION TEST FAILURE

If the required state of compaction is not obtained, it shall be the responsibility of the Contractor to re-compact or rework the material to the required state of compaction. In cases where there is a failure to achieve the required state of compaction it may be required that the backfill be removed and re-compacted or replaced at the discretion of Engineer and/or Owner.





Jacket Material Selection Chart

	Polyvinyl Chloride (PVC)	Polyethylene (PE)	Neoprene	Chlorosulphonated Polyethylene (CP)	Thermoplastic CP
Mechanical					
Abrasion Resistance	Good	Excellent	Good	Good	Excellent
Tensile Strength	Excellent	Excellent	Excellent	Excellent	Good
Elongation	Good	Excellent	Excellent	Excellent	Good
Compression Resistance	Good	Excellent	Excellent	Excellent	Good
Flexibility	Good	Fair	Excellent	Excellent	Fair
Environmental					
Flame	Good	Poor	Excellent	Excellent	Good
Fresh Water	Good	Exceptional	Excellent	Excellent	Excellent
Salt Water	Good	Exceptional	Excellent	Excellent	Excellent
Motor Oil	Good	Excellent	Good	Good	Good
Fuel Oil	Good	Slight swelling above 60 °C	Good	Good	Poor above 110 °C
Crude Oil	Good	Slight swelling above 60 °C	Good	Good	Poor above 110 °C
Creosote	Poor	Good	Fair	Fair	Good
Gasoline	Good	Excellent	Poor	Poor	Excellent
Kerosene	Good	Slight swelling at higher temperature	Poor	Poor	Slight swelling at higher temperature
Isopropyl Alcohol	Fair	Good	Fair	Good	Good
Wood Alcohol	Fair	Good	Fair	Good	Good
Grain Alcohol	Fair	Good	Fair	Good	Good
Sulfuric Acid	Excellent	Excellent	Excellent	Excellent	Excellent
Nitric Acid	Excellent	Excellent	Excellent	Excellent	Excellent
Hydrochloric Acid	Excellent	Excellent	Excellent	Excellent	Excellent
Sodium Hydroxide (Lye)	Good	Excellent	Good	Excellent	Excellent
Potassium Hydroxide (Potash)	Good	Excellent	Good	Excellent	Excellent
Calcium Hydroxide (Lime)	Good	Excellent	Poor	Fair	Excellent
Acetone	Poor	Excellent	Poor	Fair	Good
Methyl Ethyl Ketone (MEK)	Poor	Good	Poor	Fair	Good
Ethyl Acetate	Poor	Good	Poor	Fair	Good
Lacquer Thinner	Poor	Good	Poor	Fair	Good
Chloroform	Poor	Good	Poor	Fair	Good
Carbon Tetrachloride	Poor	Good	Poor	Fair	Good
Methyl Chloride	Poor	Poor	Poor	Poor	Poor
General					
Leaves protective residue after combustion	Yes	No	Yes	Yes	Yes
Oxygen index (ASTMD-2863)	23-30%	17-18%	31-39%	30-36%	30-34%
Halogen content - % weight	26	0	18	14	18-20
Minimum installation temperature	-10 °C	-40 °C	-20 °C	-20 °C	-40 °C
Dimensional stability underheat	Fair	Fair	Excellent	Excellent	Fair
Maximum operating temperature	75 °C	75 °C	90 °C	90 °C	75 °C

Note: When cables are to be installed in cold weather, they should be kept in heated storage for at least 24 hrs. before installation.



classicwire.com | sales@classicwire.com | 800.298.3500



EPR Performance Specifications

The insulation shall be a premium quality, heat, moisture, ozone and corona resistant thermosetting ethylene propylene; TYPE I, II or III as listed in ICEA S-93-639 or ICEA S-97-682. The cable manufacturer shall compound the insulation material with in its own or remotely owned facilities. The insulation shall be compatible with both the conductor shield and the insulation shield. The thickness shall be at the 100% or 133% level as applicable and in accordance with the latest edition of ICEA S-93-639, ICEA S-97-682 and UL 1072.

The diameters over the insulation shall be in accordance with ICEA S-97-682. The EPR insulation shall also meet the guaranteed values as listed in the table below.

	PHYSICAL REQUIREMENTS	GUARANTEED VALUE
Unaged	Tensile strength, psi, min.	1600
	Elongation at rupture, %, min.	275
	Tensile Stress at 200% elongation, psi, min. at room temperature	1000
	Modulus, psi, min. @ 130 °C	300
After Air Oven Aging at 121 °C for 7 days (168 hours)	Tensile stress, % of unaged value, min.	90
	Elongation at rupture, % of unaged value, min.	90
Hot Creep Test at 150 °C	Elongation, %, max.	25
	Set, %, max.	5
Heat Distortion after 1 hour in air oven at 121 °C	Percent max.	8.5
Ozone Resistance	0.030% Concentration, 25 °C, 24 hours	No Cracks
	0.0005% Concentration, 52 °C, 24 hours	No Cracks
Cold Bend	-55 °C	No Cracks
Heat Deformation Test per ASTM D2220	% Max. Distortion of buffed samples of insulation conditioned for 5 minutes and under load for 15 minutes	No Cracks





Thermal Resistivities of Materials

Material	Thermal Resistivity (ρ_T) Km/W
Insulating Materials*	
Paper insulation in solid type cables	6.0
Paper insulation in oil-filled cables	5.0
Paper insulation in cables with external gas pressure	5.5
Paper insulation in cables with internal gas pressure	
A) Pre-impregnated	5.5
B) Mass-impregnated	6.0
PE	3.5
XLPE	3.5
PPL	5.5
Polyvinyl chloride	
Up to and including 3kV cables	5.0
Greater than 3kV cables	6.0
EPR	
Up to and including 3kV cables	3.5
Greater than 3kV cables	5.0
Butyl rubber	5.0
Rubber	5.0
Protective Coverings	
Compounded jute and fibrous materials	6.0
Rubber sandwich protection	6.0
Polychloroprene	
PVC	
Up to and including 35kV cables	5.0
Greater than 35kV cables	6.0
PVC/Bitumen on corrugated aluminum sheaths	6.0
PE	3.5
Materials for Duct Installations	
Concrete	1.0
Fibre	4.8
Earthenware	1.2
PVC	6.0
PE	3.5

*For the purposes of current rating calculations, the semiconducting screening materials are assumed to have the same thermal properties as the adjacent dielectric materials. Where plastic or elastomeric materials are used for protective coverings, the thermal resistivities shall be taken to be the same as those for the insulation grades of the materials given in this table.





Guide for the Installation of ACSR Twisted Pair (TP) Conductor



ACSR/TP overhead conductor consists of two standard concentric stranded ACSR conductors twisted around each other. It may be installed using techniques and equipment similar to that used to install other concentric round wire conductors. However, a few special procedures must be used to maintain equal tension between the two component conductors. The equipment recommendations and special procedures in this guide along with recommendations given in IEEE Std. 524, "Guide to the Installation of overhead Transmission Line Conductors", should be followed.

HANDLING

It is important to maintain the relationship of the conductor lengths established during manufacturing. Therefore, ACSR/TP conductor should not be rewound in the field from the shipping reel to another reel. Reels containing ACSR/TP conductor should be stored upright, resting on the rims.

Never lay the reel on its side.

TENSIONERS & SHEAVES

Most methods of installation used for standard round conductor can be used to install ACSR/TP conductor. However, non-tension methods of stringing are preferred such as laying the conductor out on the ground and then lifting it into position on the poles.

If the conductor must be strung under tension then a multi-groove bullwheel tensioner MUST be used to install ACSR/TP conductor. A tensioner in which the alignment of the front and back bullwheels are offset by $\frac{1}{2}$ the groove spacing is satisfactory for installing smaller sizes of ACSR/TP conductor, where the conductor will lay flat in the bottom on the groove. If improper equipment is used, the ridge between the grooves may separate the individual ACSR/TP conductors.

Another commonly used tensioner has one bullwheel tilted slightly in relation to the other. This allows the conductor to ride in the bottom of the grooves. This type of tensioner, when properly sized, is preferred.

The bottom groove diameters for sheaves and bullwheels should be sized in accordance with IEEE Std. 524; except that the bottom groove for sheaves should not be less than 14 times the maximum diameter of the ACSR/TP conductor. Note that for this type of conductor the term "Dc" should be twice the diameter of one component conductor (referred to in this guide as the 'maximum diameter').

The groove radius of the sheave and bullwheel must be wide enough to allow the ACSR/TP conductor to pass through with the two individual conductors laying flat and parallel. The minimum groove radius should be 0.55 times the maximum diameter of the ACSR/TP conductor. The use of smaller than recommended diameter sheaves and/or high stringing tensions may cause a build-up of torsional stress into the conductor.

STRINGING

Each shipping length of ACSR/TP conductor has three metal bands applied at the factory around both conductors, one band at each end and one approximately 10 feet from the leading end. It is recommended that these bands not be removed for the stringing procedure, however, if the gripping device cannot be applied, then it is acceptable to remove the outer band only leaving the second band in place a few feet further up the conductor. These bands will help maintain the individual conductor length relationship when splicing and deadending.

A single woven wire grip sized to fit over both conductors and a swivel link should be used for tension stringing. Double band the open end of the grip to prevent it from accidentally coming off.

Apply tape over the bands to protect the stringing sheave surface.

TENSIONING

ACSR/TP conductor should be tensioned by placing a separate grip on each component conductor. The two grips are connected through a snatch block with a sling. Tension is applied to the snatch block with a hoist or other appropriate tensioning device. This arrangement will apply even tension to the component conductors.

SPLICING

ACSR/TP conductors are normally joined by separately splicing each component conductor. Where possible, the individual conductor splices should be staggered about 5 feet. An additional twist may be needed before the second splice is made to remove any looseness between the individual conductors. This will ensure that each component conductor carries an even share of line tension. Both splices must be made before tension is applied.

REPAIRS

Repairs to a damaged component conductor can be made using the following procedure:

1. Attach two wire grips facing each other approximately 15 feet apart on the undamaged component conductors.
2. Attach a hoist to the grips and take up tension. As the tension increases, slack will appear in the damaged conductor.
3. Increase tension until there is enough slack to make the repairs.

If it is necessary to cut the damaged conductor to install a splice, a second set of grips and hoist must be installed on the damaged conductor before it is cut. The above procedure should be followed to install the grips.

Helically applied rods may also be used for repairs in accordance with normal utility practice given the nature and severity of damage. Follow the above procedures to install the repair rods on the damaged conductor.





Wire & Cable Methods of Color Coding

Used to identify conductors for point-to-point wiring and for circuit diagrams. Color codes are used to establish a standard for use by different manufacturers.

The first color code used colored tracers in a solid colored braid. Most control cable color codes are adaptations of this method. Later, for ease and convenience, ink printed versions were developed.

Telephone requirements established special color codes.

Color Codes (ICEA Methods)

ICEA/NEMA Method 1

Colored insulation with contrasting ink tracers as required. Six different insulation colors and four different colored ink tracers are used to provide positive identification through 21 conductors. The same identification sequence is repeated for cables containing more than 21 conductors.

ICEA/NEMA Method 2

A neutral colored compound is used with single or double spiral ink tracers as required to provide positive identification through 21 conductors. The identification sequence is repeated for cables containing more than 21 conductors.

ICEA/NEMA Method 3

A neutral or single colored insulation compound is surface ink printed with both conductor number and color designation to provide positive identification through 21 conductors. The identification sequence is repeated for cables containing more than 21 conductors.

ICEA/NEMA Method 4

A neutral or single colored insulation compound is surface ink printed with conductor number to provide positive conductor identification through 21 conductors. The identification sequence is repeated for cables containing more than 21 conductors.

ICEA/NEMA Method 5

A color coding using braids. Also sometimes specified using colored insulation and contrasting tracers as an extension of Method 1 to eliminate duplicate conductors. Up to 127 positive conductor coding are available with this method. Usually specified as per: ICEA5-61-402 Table 5-1 or ICEA 5-19-81 Table 5-2.

ICEA/NEMA Method 6

A color coding whereby one conductor in each layer is identified by a braid, tape, ridge, stripe or color.

ICEA/NEMA Paired Color Code

A coding whereby one leg of all pairs is coded white and its mate is coded in accordance with the first 21 conductors of Method 1, omitting white and repeating the sequence as necessary.

Telephone Paired Color Code

Five colors are paired with each of five mate colors to give 25 identified pairs. The color sequences are repeated for more than 25 pairs using colored binder strings for group identification.

Note: UL and the NEC restrict the use of green and white as colors and stripes. Special color codes are available to meet these requirements. One method is ICEA Method E-2 which is similar to Method 1 and ICEA Method E-4 which is similar to Method 2.





Wire & Cable Methods of Color Coding

ICEA METHOD 1, TABLE E-1
(Colored compound with tracers)

Conductor Number	Background or Base Color	Tracer Color
1*	Black	-
2	White	-
3	Red	-
4	Green	-
5	Orange	-
6	Blue	-
7	White	Black
8	Red	Black
9	Green	Black
10	Orange	Black
11	Blue	Black
12	Black	White
13	Red	White
14	Green	White
15	Blue	White
16	Black	Red
17	White	Red
18	Orange	Red
19	Blue	Red
20	Red	Green
21	Orange	Green

*This conductor is in the inside of the assembly.

ICEA METHOD 2, TABLE E-1
(Neutral colored compound with tracers)

Conductor Number	First Tracer Color (Wide Tracer)	Second Tracer Color (Narrow Tracer)
1*	Black	-
2	White	-
3	Red	-
4	Green	-
5	Orange	-
6	Blue	-
7	White	Black
8	Red	Black
9	Green	Black
10	Orange	Black
11	Blue	Black
12	Black	White
13	Red	White
14	Green	White
15	Blue	White
16	Black	Red
17	White	Red
18	Orange	Red
19	Blue	Red
20	Red	Green
21	Orange	Green

*This conductor is in the inside of the assembly.

ICEA METHOD 1, TABLE E-2
(Colored compound with tracers)

Conductor Number	Background or Base Color	Tracer Color
1*	Black	-
2	Red	-
3	Blue	-
4	Orange	-
5	Yellow	-
6	Brown	-
7	Red	Black
8	Blue	Black
9	Orange	Black
10	Yellow	Black
11	Brown	Black
12	Black	Red
13	Blue	Red
14	Orange	Red
15	Yellow	Red
16	Brown	Red
17	Black	Blue
18	Red	Blue
19	Orange	Blue
20	Yellow	Blue
21	Brown	Blue
22	Black	Orange
23	Red	Orange
24	Blue	Orange
25	Yellow	Orange
26	Brown	Orange
27	Black	Yellow
28	Red	Yellow
29	Blue	Yellow
30	Orange	Yellow
31	Brown	Yellow
32	Black	Brown
33	Red	Brown
34	Blue	Brown
35	Orange	Brown
36	Yellow	Brown

*This conductor is in the inside of the assembly.





Wire & Cable Methods of Color Coding

ICEA METHOD 1, TABLE E-2
(Neutral colored compound with tracers)

Conductor Number	Background or Base Color	Tracer Color
1*	Black	-
2	Red	-
3	Blue	-
4	Orange	-
5	Yellow	-
6	Brown	-
7	Red	Black
8	Blue	Black
9	Orange	Black
10	Yellow	Black
11	Brown	Black
12	Black	Red
13	Blue	Red
14	Orange	Red
15	Yellow	Red
16	Brown	Red
17	Black	Blue
18	Red	Blue
19	Orange	Blue
20	Yellow	Blue
21	Brown	Blue
22	Black	Orange
23	Red	Orange
24	Blue	Orange
25	Yellow	Orange
26	Brown	Orange
27	Black	Yellow
28	Red	Yellow
29	Blue	Yellow
30	Orange	Yellow
31	Brown	Yellow
32	Black	Brown
33	Red	Brown
34	Blue	Brown
35	Orange	Brown
36	Yellow	Brown

*This conductor is in the inside of the assembly.

ICEA METHOD 3
(Neutral or single color compound with surface printing of numbers and color designations)

Conductor Number	Printed Legend
1*	1 - Black
2	2 - White
3	3 - Red
4	4 - Green
5	5 - Orange
6	6 - Blue
7	7 - White-Black
8	8 - Red-Black
9	9 - Green-Black
10	10 - Orange-Black
11	11 - Blue-Black
12	12 - Black-White
13	13 - Red-White
14	14 - Green-White
15	15 - Blue-White
16	16 - Black-Red
17	17 - White-Red
18	18 - Orange-Red
19	19 - Blue-Red
20	20 - Red-Green
21	21 - Orange-Green

*This conductor is in the inside of the assembly.

ICEA METHOD 4
(Neutral or single color compound with surface printing of numbers)

Conductor Number	Printed Legend
1*	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21

*This conductor is in the inside of the assembly.





Wire & Cable Methods of Color Coding

ICEA METHOD 5

(Colored compounds with tracers)

Cond. Number	Background or Base Color	First Tracer Color	Second Tracer Color	Cond. Number	Background or Base Color	First Tracer Color	Second Tracer Color	Cond. Number	Background or Base Color	First Tracer Color	Second Tracer Color
1*	Black	-	-	44	Black	White	Blue	87	Black	Orange	-
2	White	-	-	45	White	Black	Blue	88	White	Orange	-
3	Red	-	-	46	Red	White	Blue	89	Red	Orange	-
4	Green	-	-	47	Green	Orange	Red	90	Green	Orange	-
5	Orange	-	-	48	Orange	Red	Blue	91	Blue	Orange	-
6	Blue	-	-	49	Blue	Red	Orange	92	Black	Blue	-
7	White	Black	-	50	Black	Orange	Red	93	White	Blue	-
8	Red	Black	-	51	White	Black	Orange	94	Red	Blue	-
9	Green	Black	-	52	Red	Orange	Black	95	Green	Blue	-
10	Orange	Black	-	53	Green	Red	Blue	96	Orange	Blue	-
11	Blue	Black	-	54	Orange	Black	Blue	97	Yellow	-	-
12	Black	White	-	55	Blue	Black	Orange	98	Yellow	Black	-
13	Red	White	-	56	Black	Orange	Green	99	Yellow	White	-
14	Green	White	-	57	White	Orange	Green	100	Yellow	Red	-
15	Blue	White	-	58	Red	Orange	Green	101	Yellow	Green	-
16	Black	Red	-	59	Green	Black	Blue	102	Yellow	Orange	-
17	White	Red	-	60	Orange	Green	Blue	103	Yellow	Blue	-
18	Orange	Red	-	61	Blue	Green	Orange	104	Black	Yellow	-
19	Blue	Red	-	62	Black	Red	Blue	105	White	Yellow	-
20	Red	Green	-	63	White	Orange	Blue	106	Red	Yellow	-
21	Orange	Green	-	64	Red	Black	Blue	107	Green	Yellow	-
22	Black	White	Red	65	Green	Orange	Blue	108	Orange	Yellow	-
23	White	Black	Red	66	Orange	White	Red	109	Blue	Yellow	-
24	Orange	Black	White	67	Blue	White	Red	110	Black	Yellow	Red
25	Blue	Black	White	68	Black	Green	Blue	111	White	Yellow	Red
26	Red	Black	White	69	White	Green	Blue	112	Green	Yellow	Red
27	Orange	Black	White	70	Red	Green	Blue	113	Orange	Yellow	Red
28	Black	Red	Green	71	Green	White	Red	114	Blue	Yellow	Red
29	White	Red	Green	72	Orange	Red	Black	115	Black	Yellow	White
30	Red	Black	Green	73	Blue	Red	Black	116	Red	Yellow	White
31	Green	Black	Orange	74	Black	Orange	Blue	117	Green	Yellow	White
32	Orange	Black	Green	75	Red	Orange	Blue	118	Orange	Yellow	White
33	Blue	White	Orange	76	Green	Red	Black	119	Blue	Yellow	White
34	Black	White	Orange	77	Orange	White	Green	120	Black	Yellow	Green
35	White	Red	Orange	78	Blue	White	Green	121	White	Yellow	Green
36	Orange	White	Blue	79	Red	White	Orange	122	Red	Yellow	Green
37	White	Red	Blue	80	Green	White	Orange	123	Orange	Yellow	Green
38	Black	White	Green	81	Blue	Black	Green	124	Blue	Yellow	Green
39	White	Black	Green	82	Orange	White	-	125	Black	Yellow	Blue
40	Red	White	Green	83	Green	Red	-	126	White	Yellow	Blue
41	Green	White	Blue	84	Black	Green	-	127	Red	Yellow	Blue
42	Orange	Red	Green	85	White	Green	-				
43	Blue	Red	Green	86	Blue	Green	-				

*This conductor is in the inside of the assembly.





Recommended Reel Handling Practices How to Handle Cable Reels

YES


NO



Cradle both reel flanges between forks.




Upended heavy reels will often arrive damaged. Refuse or receive subject to inspection for hidden damage.

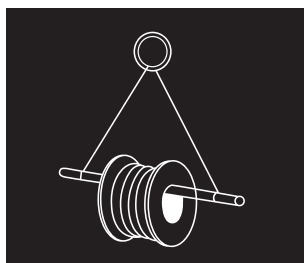


Reels can be hoisted with a shaft extending through both flanges.




Do not lift by top flange. Cable or reel will be damaged.

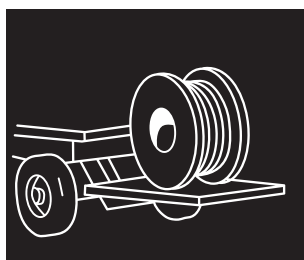


Lower reels from truck using hydraulic gate, hoist or fork lift.
LOWER CAREFULLY!



Never allow forks to touch cable surface or reel wrap.

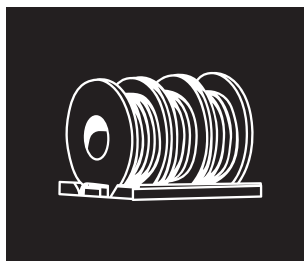

Always load with flanges on edge and chock and block securely.




Never drop reels.





Steel Reel Specifications

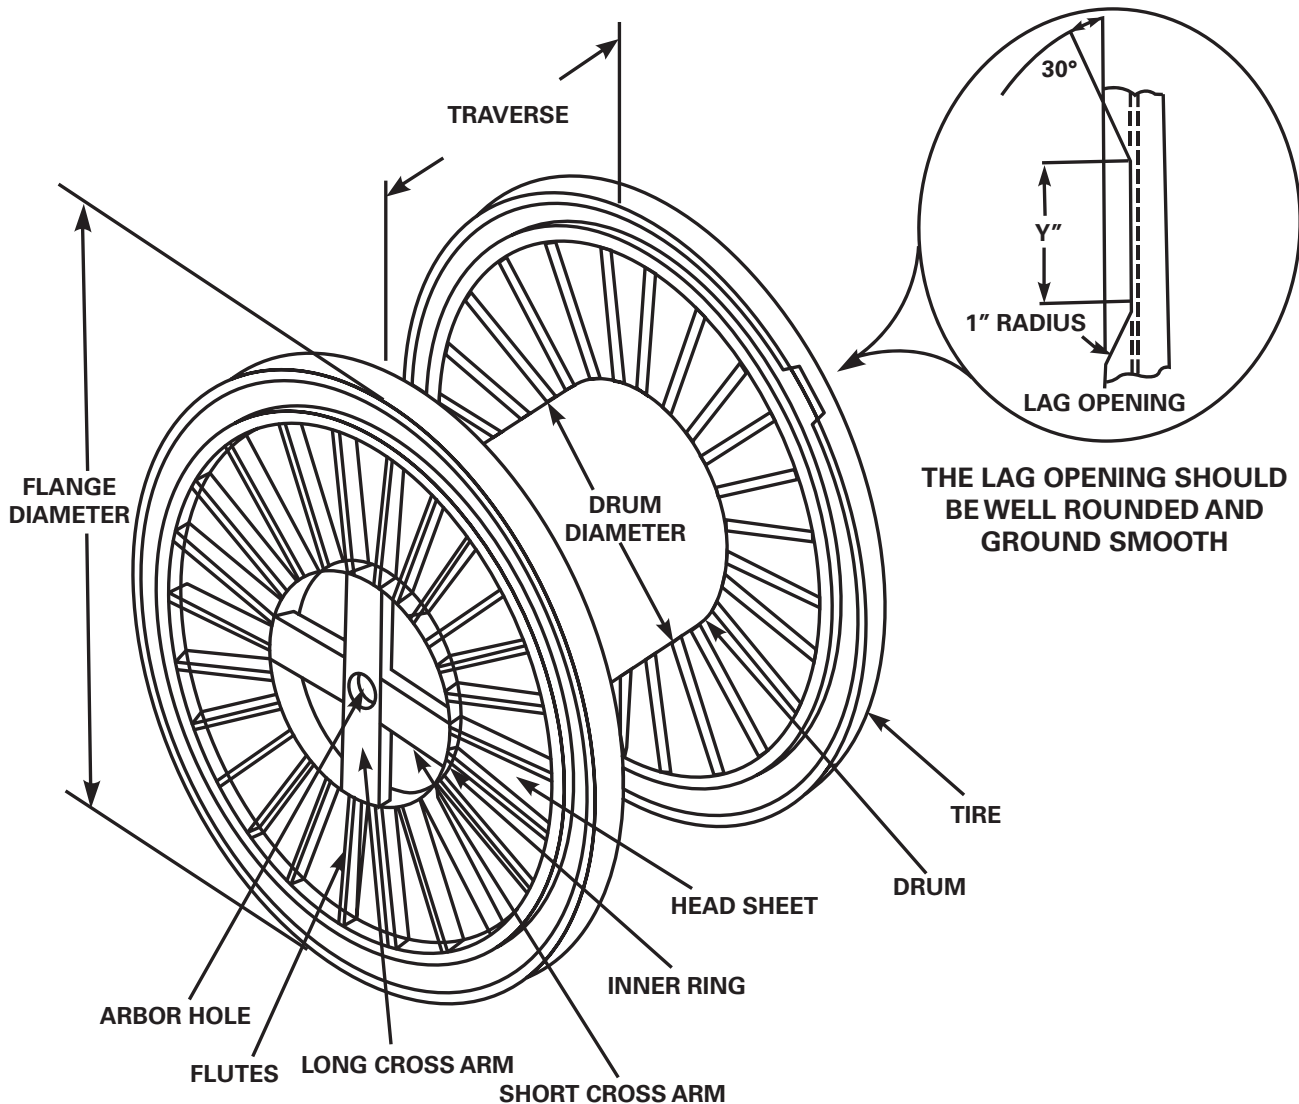

I-BEAM TIRE FLUTED STEEL REEL—TYPE RMT

NOTE — When required, cable test hole in the flange shall not have more than 3 flutes removed to provide this opening. The cable test hole shall be reinforced along the cutout with a metal equal to or greater than that required for use in the drum of the reel. Height of cable test hole to be no greater than one-half the length.





Steel Reel Specifications

Type*	-Reel Dimensions-			Max. Overall Width (in)	Arbor Hole Diameter (in)	Max. Number of Flutes per Hd	Tire Size (in)	----Cross Arms----			Drum U.S.S. (ga)	Inner Ring Dimensions (in)	(Flange) Head Sheet U.S.S. (ga)	Maximum Capacity---	
	Fl	Trav	Drum					U.S.S. (ga)	Long (in)	Short (in)				(lb)	(kg)
RM	42	24	24	33	3.25	24	2x5/16	8	5x2	4x2	12	3-3/4x3/16	16	1,956	887
RM	48	24	24	33	3.25	24	2x5/16	8	5x2	4x2	12	3-3/4x3/16	16	3,072	1,393
RM	54	32	32	41	3.25	30	2x5/16	8	5x2	4x2	12	3-3/4x3/16	16	4,464	2,024
RM	60	32	32	41	3.25	30	2x5/16	8	5x2	4x2	12	3-3/4x3/16	16	6,360	2,884
RM	66	32	36	41	3.25	32	2-1/2x1/2	8	6x2	5x2	12	3-3/4x3/16	16	7,680	3,482
RM	72	36	40	45	3.25	40	2-1/2x1/2	8	6x2	5x2	12	3-3/4x1/4	16	10,260	4,654
RM	72	36	48	45	3.25	40	2-1/2x1/2	8	6x2	5x2	12	3-3/4x1/4	16	7,872	3,570
RM	78	36	48	45	3.25	40	2-1/2x5/8†	8	6x2	5x2	12	3-3/4x1/4	16	10,752	4,876
RMT	84	36	42	45	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x2	6x2	10	4x1/4	16	13,608	6,171
RMT	84	45	42	55	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x2	6x2	10	4x1/4	16	17,004	7,711
RMT	84	45	56	55	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x2	6x2	10	4x1/4	16	11,196	5,050
RMT	90	45	42	55	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x2	6x2	10	4-1/4x1/4	16	21,036	9,540
RMT	90	45	56	55	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x2	6x2	10	4-1/4x1/4	16	15,216	6,900
RMT	90	54	56	64	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x2	6x2	8	4-1/4x1/4	16	18,252	8,277
RMT	96	60	42	71	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x3	6x3	8	4-1/2x5/16	14	26,000	11,719
RMT	98	60	56	71	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x3	6x3	8	4-1/2x5/16	14	26,000	11,719
RMT**	108	74	56	85	5.25	40	7.5lb/ft, 3" I-Beam	8	7-7/8x3	6x3	8	4-1/2x5/16	14	30,000	13,605

* RM—Flat bar tire

** Generally used for aluminum wire and cable

† Alternate size is 3x1/2 inch

RMT—I-Beam Tire

NOTE—Tie holes, if necessary, shall be in the flat portion of the head sheet. There will be no holes in the flute itself.

NOTE—A range of 3 to 3.25-inch and 5 to 5.25-inch arbor hole diameter shall be permitted for existing reels until the year 2005.

WELDING REQUIREMENTS FOR CLASS 1 REELS

Head sheet to tire—at all radii of flute-intermittent weld

Head sheet to inner ring—at all radii of flute-intermittent weld

Drum to inner ring—intermittent weld

Cross arm to cross arm—continuous weld

Cross arm to inner ring—continuous weld

Cross arm to hub—continuous weld

Back-up plate to hub and cross arm—continuous weld


Port frame—continuous weld

All welds shall reflect good welding practice with proper penetration.





Paralleling

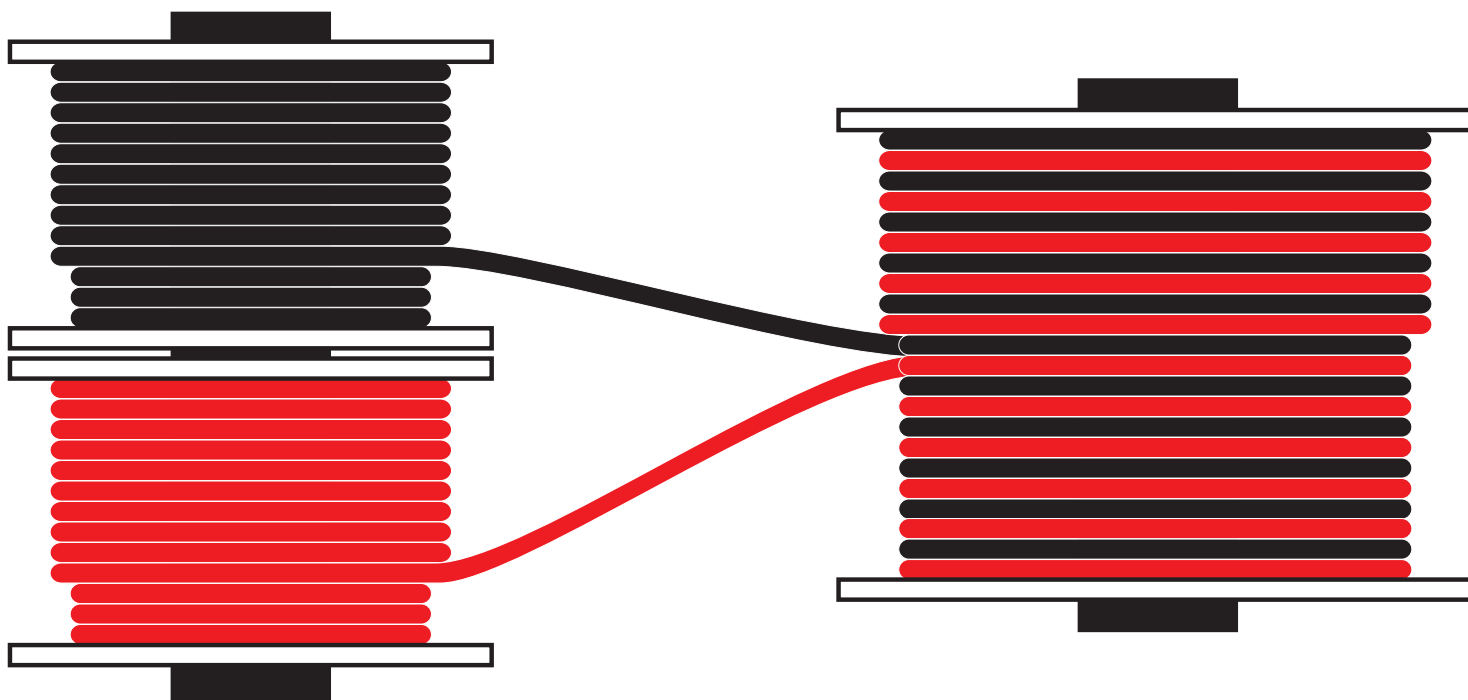



Metric IEC Size Compared to AWG or kcmil Size with Equivalent Metric Size

Area (mm ²)	Size AWG or kcmil	Nominal Overall Diameter (mm)	Nominal Overall Diameter (in)	Number of Wires	Area (mm ²)	Size AWG or kcmil	Nominal Overall Diameter (mm)	Nominal Overall Diameter (in)	Number of Wires
1010	2000	41.45	1.63	127	42.41	1	8.43	0.33	19
1000		41.14	1.62	91	35		7.65	0.30	19
887	1750	38.76	1.53	127	35		7.56	0.30	7
800		36.81	1.45	61	33.62	2	7.42	0.29	7
760	1500	35.87	1.41	91	26.67	3	6.61	0.26	7
633	1250	32.74	1.29	91	25		6.39	0.25	7
507	1000	29.26	1.15	61	21.15	4	5.89	0.23	7
500		29.05	1.14	37	16		5.13	0.20	7
400		25.97	1.02	37	13.3	6	4.67	0.18	7
380	750	25.35	0.10	61	10		4.05	0.16	7
304	600	22.68	0.89	61	8.37	8	3.71	0.15	7
300		22.46	0.88	37	6		3.12	0.12	7
253.4	500	20.65	0.81	37	5.26	10	2.95	0.12	7
240		20.09	0.79	37	4		2.55	0.10	7
203	400	18.49	0.73	37	3.31	12	2.34	0.09	7
185		17.64	0.70	37	2.5		2.01	0.08	7
177	350	17.3	0.68	37	2.08	14	1.85	0.07	7
152	300	16	0.63	37	1.5		1.56	0.06	7
150		15.85	0.62	19	1.31	16	1.47	0.06	7
127	250	14.61	0.58	37	1		1.29	0.05	7
120		14.15	0.56	19	0.82	18	1.02	0.05	7
107.2	4/0	13.41	0.53	19	0.75		0.98	0.04	7
95		12.6	0.50	19	0.52	20	0.81	0.03	7
85.01	3/0	11.94	0.47	19	0.5		0.8	0.03	7
70		10.86	0.43	19	0.33	22	0.64	0.03	7
67.43	2/0	10.64	0.42	19	0.25		0.56	0.02	7
53.49	1/0	9.47	0.37	19	0.2	24	0.51	0.02	7
50		9.15	0.36	19					





Copper Conductor Stranding Chart Class A thru M

Size (AWG or kcmil)	Overall Diameter (in)	Weight (lb / 1000 ft)	ROPE LAY						
			Class A	Concentric Strand			Concentric Strand		Bunch Strand
				Class B	Class C	Class D	Class G	Class H	Class I
36	0.005	0.076	N/A	N/A	N/A	N/A	N/A	N/A	N/A
35	0.006	0.095	N/A	N/A	N/A	N/A	N/A	N/A	N/A
34	0.006	0.120	N/A	N/A	N/A	N/A	N/A	N/A	N/A
33	0.007	0.152	N/A	N/A	N/A	N/A	N/A	N/A	N/A
32	0.008	0.191	N/A	N/A	N/A	N/A	N/A	N/A	N/A
30	0.009	0.241	N/A	N/A	N/A	N/A	N/A	N/A	N/A
30	0.01	0.304	N/A	N/A	N/A	N/A	N/A	N/A	N/A
29	0.011	0.384	N/A	N/A	N/A	N/A	N/A	N/A	N/A
28	0.013	0.484	N/A	N/A	N/A	N/A	N/A	N/A	N/A
27	0.014	0.61	N/A	N/A	N/A	N/A	N/A	N/A	N/A
26	0.016	0.769	N/A	N/A	N/A	N/A	N/A	N/A	N/A
25	0.018	0.970	N/A	N/A	N/A	N/A	N/A	N/A	N/A
24	0.020	1.223	N/A	N/A	N/A	N/A	N/A	N/A	N/A
23	0.023	1.542	N/A	N/A	N/A	N/A	N/A	N/A	N/A
22	0.025	1.945	N/A	N/A	N/A	N/A	N/A	N/A	N/A
21	0.029	2.452	N/A	N/A	N/A	N/A	N/A	N/A	N/A
20	0.036	3.154	N/A	7	19	N/A	N/A	N/A	N/A
18	0.046	5.015	N/A	7	19	N/A	N/A	N/A	N/A
16	0.058	7.974	N/A	7	19	N/A	N/A	N/A	N/A
14	0.073	12.68	N/A	7	19	37	49	N/A	N/A
12	0.092	20.16	N/A	7	19	37	49	N/A	N/A
10	0.116	32.06	N/A	7	19	37	49	N/A	26
9	0.13	40.42	N/A	7	19	37	49	133	N/A
8	0.146	51	N/A	7	19	37	49	133	41
6	0.184	80.9	N/A	7	19	37	49	133	63
4	0.232	129	7	7	19	37	49	133	105
3	0.26	162	7	7	19	37	49	133	N/A
2	0.292	205	7	7	19	37	49	133	161





Copper Conductor Stranding Chart Class A thru M

Size (AWG or kcmil)	Overall Diameter (in)	Weight (lb / 1000 ft)	ROPE LAY						
			Class A	Concentric Strand			Concentric Strand		Bunch Strand
				Class B	Class C	Class D	Class G	Class H	Class I
1	0.332	259	7	19	37	61	133	259	210
1/0	0.373	326	7	19	37	61	133	259	266
2/0	0.419	411	7	19	37	61	133	259	342
3/0	0.47	518	7	19	37	61	133	259	418
4/0	0.528	653	7	19	37	61	133	259	532
250	0.575	772	19	37	61	91	259	427	637
300	0.63	925	19	37	61	91	259	427	735
350	0.681	1080	19	37	61	91	259	427	882
400	0.728	1236	19	37	61	91	259	427	980
500	0.813	1542	37	37	61	91	259	427	1225
600	0.893	1850	37	61	91	127	427	703	1470
750	0.998	2316	61	61	91	127	427	703	1862
1000	1.152	3086	61	61	91	127	427	703	2527

NOTE: Dimensions and weights are nominal values, subject to standard manufacturing tolerances.



classicwire.com | sales@classicwire.com | 800.298.3500



Allowable Ampacities of Insulated Conductors

ALLOWABLE AMPACITIES OF INSULATED ALUMINUM OR COPPER-CLAD ALUMINUM CONDUCTORS

- Rated Up to and Including 2000 Volts, 60 °C through 90 °C (140 °F through 194 °F).
- Not More Than Three Current-Carrying Conductors in Raceway, Cable, or Earth (Directly Buried).
- Based on Ambient Temperature of 30 °C (86 °F)



Conductor Size (AWG or kcmil)	90 °C (194 °F)		
	60 °C (140 °F)	75 °C (167 °F)	90 °C (194 °F)
	TW, UF	RHW, THHW, THW, THWN, XHHW, USE, ZW	TBS, SA, SIS, FEP, FEPB, MI, RHH, RHW-2, THHN, XHH, XHHW, XHHW-2, USE-2, ZW
14*	-	-	-
12*	15	20	25
10*	25	30	35
8	35	40	45
6	40	50	55
4	55	65	75
3	65	75	85
2	75	90	100
1	85	100	115
1/0	100	120	135
2/0	115	135	150
3/0	130	155	175
4/0	150	180	205
250	170	205	230
300	195	230	260
350	210	250	280
400	225	270	305
500	260	310	350
600	285	340	385
700	315	375	425
750	320	385	435
800	330	395	445
900	355	425	480
1000	375	445	500

ALLOWABLE AMPACITIES OF INSULATED COPPER CONDUCTORS

- Rated Up to and Including 2000 Volts, 60 °C through 90 °C (140 °F through 194 °F).
- Not More Than Three Current-Carrying Conductors in Raceway, Cable, or Earth (Directly Buried).
- Based on Ambient Temperature of 30 °C (86 °F).



Conductor Size (AWG or kcmil)	90 °C (194 °F)		
	60 °C (140 °F)	75 °C (167 °F)	90 °C (194 °F)
	TW, UF	RHW, THHW, THW, THWN, XHHW, USE, ZW	TBS, SA, SIS, FEP, FEPB, MI, RHH, RHW-2, THHN, XHH, XHHW, XHHW-2, USE-2, ZW
14*	15	20	25
12*	20	25	30
10*	30	35	40
8	40	50	55
6	55	65	75
4	70	85	95
3	85	100	115
2	95	115	130
1	110	130	145
1/0	125	150	170
2/0	145	175	195
3/0	165	200	225
4/0	195	230	260
250	215	255	290
300	240	285	320
350	260	310	350
400	280	335	380
500	320	380	430
600	350	420	475
700	385	460	520
750	400	475	535
800	410	490	555
900	435	520	585
1000	455	545	615

* Unless specifically permitted in 240.4(E) through (G), the overcurrent protection shall not exceed 15 amperes for 14 AWG, 20 amperes for 12 AWG, and 30 amperes for 10 AWG copper; or 15 amperes for 12 AWG and 25 amperes for 10 AWG aluminum and copper-clad aluminum after any correction factors for ambient temperature and number of conductors have been applied.

See the NEC for conductor ampacities, correction factors, and conditions of use.





Wire & Cable Glossary of Terms

AWG

Abbreviation for American Wire Gauge.

Alternating Current

Electric current that continually reverses its direction. Is expressed in cycles per second (hertz or Hz).

Ambient Temperature

The temperature of the medium (gas, liquid or earth) surrounding an object.

American Mustang

A premium grade thermoset cord, UL listed as SOOW or SJOOW, CSA SOOW and SJOOW.

American Wire Gauge (AWG)

A standard system for designating wire diameter. Also referred to as the Brown and Sharpe (B&S) wire gauge.

Ampacity

See Current Carrying Capacity.

Ampere

The unit of current. One ampere is the current flowing through one ohm of resistance at one volt potential.

Anneal

Relief of mechanical stress through application of heat and gradual cooling. Annealing copper renders it soft and less brittle.

Audio Frequency

The range of frequencies audible to the human ear. Usually 20–20,000Hz.

Braid

A fibrous or metallic group of filaments interwoven in cylindrical form to form a covering over one or more wires.

Breakdown Voltage

The voltage at which the insulation between two conductors breaks down.

Bunch Stranding

A group of wires of the same diameter twisted together without a predetermined pattern.

Cabling

The twisting together of two or more insulated conductors to form a cable.

Capacitance

The ability of a dielectric material between conductors to store electricity when a difference of potential exists between the conductors. The unit of measurement is the farad, which is the capacitance value that will store a charge of one coulomb when a one-volt potential difference exists between the conductors. In AC, one farad is the capacitance value that will permit one ampere of current when the voltage across the capacitor changes at a rate of one volt per second.

Circuit (Electric)

The complete path of an electrical current. When the continuity is broken, it is called an open circuit; when continuity is maintained, it is called a closed circuit.

Cold Flow

Permanent deformation of the insulation due to mechanical force or pressure (not due to heat softening).

Color Code

A system for circuit identification through use of solid colors and contrasting tracers.

Compound

An insulating or jacketing material made by mixing two or more ingredients.

Concentricity

In a wire or cable, the measurement of the location of the center of the conductor with respect to the geometric center of the surrounding insulation.

Conductor

An uninsulated wire suitable for carrying electrical current.

Contacts

The parts of the connector that actually carry the electrical current and that touch the equivalent parts in the mating connector.

Continuity Check

A test to determine whether electrical current flows continuously throughout the length of a single wire or individual wires in a cable.

Cord

A flexible insulated wire suitable for carrying electric current.

Corona

Ionization of air surrounding a conductor caused by the influence of high voltage. Causes deterioration of insulation materials.

Crazing

The minute cracks on the surface of plastic materials.

CSA

Abbreviation for Canadian Standards Association, a nonprofit, independent organization that operates a listing service for electrical and electronic materials and equipment. The Canadian counterpart of the Underwriters Laboratories

Current Carrying Capacity

The maximum current an insulated conductor can safely carry without exceeding its insulation and jacket temperature limitations. It is dependent on the installation conditions.

Decibel (db)

A unit that expresses differences of power or voltage level. It is used to express power loss in passive circuits or cables.

Dielectric Strength

The voltage that an insulation can withstand before breakdown occurs. Usually expressed as a voltage gradient (such as volts per mil).

Direct Capacitance

The capacitance measured directly from conductor to conductor through a single insulating layer.

Drain Wire

In a cable, the uninsulated wire laid over the shield component or components and used as a ground connection.

Drawing

In wire manufacture, pulling the metal through a die or series of dies to reduce diameter to a specified size.





Wire & Cable Glossary of Terms

Eccentricity

Like concentricity, a measure of the center of a conductor's location with respect to the circular cross section of the insulation. Expressed as a percentage of displacement of one circle within the other.

Elongation

The fractional increase in length of a material stressed in tension.

EMI

Abbreviation for electromagnetic interference.

Farad

A unit of electrical capacitance.

Filler

1) A material used in multiconductor cables to occupy large interstices formed by the assembled conductors;
2) An inert substance added to a compound to improve properties or decrease cost.

Flame Resistance

The ability of a material to resist the propagation of flame once the heat source is removed.

Flex Life

The measurement of the ability of a conductor or cable to withstand repeated bending.

Frequency

The number of times an alternating current repeats its cycle in one second.

Gauge

A term used to denote the physical size of a wire.

Ground

An electrical term meaning to connect to the earth or other large conducting body to serve as an earth, thus making a complete electrical circuit.

Harness

An arrangement of wires and cables, usually with many breakouts, which have been tied together or pulled into a rubber or plastic sheath, used to interconnect an electric circuit.

Hertz (Hz)

A term replacing cycles per second as an indication of frequency.

Hi-Pot

A test designed to determine the highest voltage that can be applied to a conductor without breaking through the insulation.

Impedance

The total opposition that a circuit offers to the flow of alternating current or any other varying current at a particular frequency. It is a combination of resistance R and reactance X, measured in ohms.

Inductance

The property of a circuit or circuit element that opposes a change in current flow, thus causing current changes to lag behind voltage changes. It is measured in henrys.

Insulation

A material having high resistance to the flow of electric current. Often called a dielectric in radio frequency cable.

Jacket

An outer non-metallic protective covering applied over an insulated wire or cable.

Jumper Cable

A short flat cable interconnecting two wiring boards or devices.

Lay

The length measured along the axis of a wire or cable required for a single strand (in stranded wire) or conductor (in cable) to make one complete turn about the axis of the conductor or cable.

Longitudinal Shield

A tape shield, flat or corrugated, applied longitudinally with the axis of the core being shielded.

Multiconductor

More than one conductor within a single cable complex.

Mylar

A synthetic compound with high dielectric qualities made by DuPont and used extensively in the wire and cable industry in tape form.

NEMA

Abbreviation for National Electrical Manufacturers Association.

Ohm

A unit of electrical resistance.

OSHA

Abbreviation for Occupational Safety and Health Act, specifically the Williams Steiger Law passed in 1970 covering all factors relating to safety in places of employment.

Plasticizer

A chemical agent added to plastics to make them softer and more pliable.

Potting

The sealing of a cable termination or other component with a liquid that cures into an elastomer.

Primary Insulation

The first layer of nonconductive material applied over a conductor, whose prime function is to act as electrical insulation.

Put-Up

Packaging of finished wire or cable by size and length.

PVC

Abbreviation for polyvinyl chloride.

Rated Voltage

The maximum voltage at which an electrical component can operate for extended periods without undue degradation or safety hazard.

REA

Abbreviation for Rural Electrification Administration, which is part of the US Dept. of Agriculture. REA establishes specifications and provides approval for telephone station wire and power cables.





Wire & Cable Glossary of Terms

Resistance

A measure of the difficulty in moving electrical current through a medium when voltage is applied. It is measured in ohms.

RFI

Abbreviation for radio frequency interference.

Separator

Pertaining to wire and cable, a layer of insulating material such as textile paper, Mylar, etc., which is placed between a conductor and its dielectric, between a cable jacket and the components it covers, or between various components of multiple conductor cable. It can be utilized to improve stripping qualities and/or flexibility, or can offer additional mechanical or electrical protection to the components it separates.

Shield

A tape shield, or braid of metal, usually copper, aluminum or other conducting material, placed around or between electric circuits or cables or their components to contain any unwanted radiation, or to keep out an unwanted interference.

Spacing

Distance between the closest edges of two adjacent conductors.

Spark Test

A test designed to locate pinholes in the insulation of a wire or cable by application of a voltage for a very short period of time while the wire is being drawn through a field of electrodes.

Spiral Wrap

The helical wrap of a tape or other material over a core or component.

Strand

A single uninsulated wire.

Stranded Conductor

A conductor composed of wires or groups of wires twisted together.

Surge

A temporary and relatively large increase in the voltage or current in an electric circuit or cable. Also called a transient.

Tensile Strength

The pull stress required to break a given specimen.

Thermoplastic

A material that softens and melts when heated and becomes firm on cooling.

Thermoset

A material that hardens or sets when heat is applied and that, once set, cannot be resoftened by heating. This material is cured with heat or radiation.

TPE

Abbreviation for Thermoplastic Elastomer.

UL

Abbreviation for Underwriters Laboratories, a nonprofit independent organization that operates a listing service for electrical and electronic materials and equipment.

Voltage

The term most often used in place of electromotive force, potential, potential difference or voltage drop to designate the electrical pressure that exists between two points and is capable of producing a current when a closed circuit is connected between two points.

VW-1

A flammability rating established by Underwriters Laboratories for wires and cables that pass a specific vertical flame test, formerly designated FR-1.

Water Resistant

UL designation for cords that have an insulation on the individual conductors that passes UL requirements (e.g., 5T Water Resistant or 5T Dry 105 °C, Water Resistant 60 °C).

